

I BUILT™

Building Systems

September 2014

Design and Installation Guide



Contents

| | | | |
|--|-----------|--|-----------|
| Scope of this Document | 4 | J-Ply Floor Fixing – Details | 33 |
| Compliance | 5 | Double Beam Connections | 34 |
| FSC & PEFC Chain of Custody Certification | 6 | Holes in LP I-Beams..... | 35 |
| Hyne Producer Statement | 7 | Holes in LP I-Beams..... | 36 |
| Pryda Producer Statement | 8 | Service Holes Hyne Beam & Hyne LGL | 37 |
| David Reid - HD NZ Certification Letter | 9 | Overcoming Splitting / Taper Cuts - LGL, 17C & LVL..... | 38 |
| David Reid - LPI Joists Certification Letter | 10 | Standard Lintels, Defining Roof Load Width, I-Built J90 LVL | 39 |
| Hyne Design Software | 11 | Standard Lintel - I-Built 90 LVL, I-Built LVL 13 | 40 |
| I-Built Structural Components | 12 | Standard Lintel - Hyne LGL 44, I-Built LVL 11, Hyne Beam 17C..... | 41 |
| Product Summary..... | 15 | Standard Lintel - Hyne Beam 17C | 41 |
| Structural Properties - LVL / LGL..... | 16 | Roof Construction Plan..... | 42 |
| LPI I-Beam Structural Properties | 17 | Rafter Span - LPI I-Beam & Hyne LGL 44mm | 43 |
| Typical Floor Construction Plan | 18 | Rafter Span - LPI I-Beam | 43 |
| Floor Joist Span - LPI I-Beams..... | 19 | Rafter Span - Hyne LGL 44mm..... | 43 |
| Floor Joist Span - Hyne LGL 44mm | 20 | Rafter Span - I-Built LVL 13 - 45mm | 44 |
| Floor Joist Span - I-Built LVL 11 | 22 | Rafter Span - I-Built LVL 13 - 63mm | 45 |
| Floor Joist Span - I-Built LVL 13 | 23 | Roof Details..... | 46 |
| Cantilever Floor Joist Details..... | 25 | Hanger Fixings..... | 48 |
| Cantilever Floor Joist Details / Fixing Details..... | 26 | Avoid These Practices..... | 49 |
| Hanger Fixings..... | 27 | Storage, Handling and Safety | 50 |
| Internal Bracing & Web Stiffener Detail | 30 | Chemical Treatment of I-Beams, LGL Edgebeams, 17C, LVL, Rimboard & Plywood..... | 51 |
| Boundary Details | 31 | | |
| Bracing and Blocking & Apron Roof Detail..... | 32 | | |

Scope of this Document

The span tables and construction details contained in this document have been developed primarily for domestic/residential applications in accordance with the principles and intent of NZS3604:2011 'Timber Framed Buildings'; NZS3603:1993 'Timber Structures Standard'; AS1720.1:2010 'Timber Structures – Design Methods'. Loading data is taken from AS/NZS1170:2002 'Structural Design Actions' to satisfy the requirements of Section B1 of the New Zealand Building Code.

All technical information and span tables in this guide are in accordance with the product specific design properties. This data may be used for specific engineering design in applications outside the scope of this document. Please refer to New Zealand Wood Products Ltd for the 'Engineering Data'.

The information in this design guide has been checked and verified, however, it should only be used by designers who are suitably qualified.

NZWOOD accepts no liability or responsibility if the information contained in this document is incorrectly interpreted, inappropriately applied, or used in a manner other than explicitly set out in this design guide.

Note: Other manufacturers' products may have different properties and therefore cannot be substituted or designed using information contained in this document.

Compliance with the New Zealand Building Code (NZBC)

This design guide offers information for designing and installing NZWOOD's I-Built engineered timber products as floor and roof framing systems in both residential and commercial buildings. Additional design guidance can also be achieved by downloading the Hyne Design (HD) software available from the NZWOOD website.

The use of this guide is intended for suitably qualified designers to be able to select engineered beam or framing sizes and to provide installation details for floor and roof construction in the NZ building industry.

Products

The full I-Built Engineered Timber and Ply range is product certified by the Engineered Wood Products Association of Australasia (EWPAA). All NZWOOD's products are manufactured in accordance with AS/NZS 4357.0:2005 and AS/NZS 2269.

LP® SolidStart™ I-Beams are an engineered 'I-Beam' supplied by Louisiana Pacific®. The top and bottom flanges are Laminated Veneer Lumber (LVL) made from strong and naturally durable Douglas Fir timber. Engineered I-Beams are intended to be used as structural floor or roof members and are manufactured in line with the requirements of AS/NZS 4357:2005 Structural Laminated Veneer Lumber. The webs are made from strong OSB (Orientated Strand Board).

Hyne Timber produce a range of Glued-laminated timber products (Glulam). Glulam is produced by finger jointing and gluing shorter and small cross section timber together to make a larger cross section final product.

All Hyne Glued-laminated products are produced at the Maryborough Glulam plant in Brisbane and are manufactured in accordance with AS/NZS 1328.1:1998. The site operates an AS4707-2006 Chain of Custody compliant management system that covers all laminated products produced at the site as well as holding ISO9001:2006 accreditation for its manufacturing systems.

I-Built LVL (Laminated Veneer Lumber) is an engineered wood composite made from 3-4mm thick rotary peeled veneers that have been laid up with parallel grain orientation. One of the main features of LVL is to disperse or remove strength-reducing characteristics of natural wood, i.e. knots and splits. LVL is engineered, highly predictable, dimensionally stable and resists warping and twisting. Veneer sheets are graded ultrasonically and are orientated within the product to maximise the potential of the stiffer and stronger veneer grades. LVL is manufactured using a phenolic adhesive in a continuous assembly. All I-Built LVL is produced in NZ mills that have been certified by the EWPAA.

Design

NZWOOD's engineered timber products that are used to calculate the span tables in this design guide were determined in accordance with NZS 3603:1993 Timber Structures Standard which is an Acceptable Solution to the New Zealand Building Code Clause 1 Structure.

Guidance has also been taken from AS 1684.1:1999, Residential timber-framed construction in the preparation of this guide and complies with NZS 3604:2011 Timber Framed Buildings which is an Acceptable Solution to NZBC Clause 1 Structure.

The requirements set out in the New Zealand Building Code will be achieved when floor joists and rafter framing components are installed in accordance with this design guide.

This design guide has been prepared and designed within the requirements of the following standards:

- AS/NZS 1170:2002 Structural Design Actions
- AS 1720.1:2010 Timber Structures, Part 1: Design methods.

Durability

NZWOOD's LP I-Beam, Hyne Timber LGL and LVL members' service life is in excess of 50 years when in dry well protected areas where moisture levels are maintained below the requirements specified in NZS 3602:2003. Buildings must remain weather tight and structural framing members must be protected from internal and external moisture exposure. Designers must ensure products specified are fit for purpose and building owners should ensure products remain protected.

Engineered I-Beams, LGL and LVL framing is not suitable in weather exposed applications. Light wetting during construction periods will not affect the performance of framing members, components must be left to dry before applying framing loads.

Note: Damaged, warped or delaminating engineered timber products should not be installed into a building. Please contact NZWOOD if there are any concerns with faulty products prior to installation.

Treatment of Engineered Timber Products

The I-Built engineered product range is available both untreated and H3.1 LOSP treated for use for weather-protected applications noted in NZS 3602:2003. LVL with an H1.2 glue-line treatment can also be supplied on request. Please enquire with NZWOOD products for availability.

All I-Built engineered products must be installed fully protected from the weather.

Note:

- It is currently acceptable to install untreated engineered timber products in internal weather protected areas as defined by NZS 3602:2003.
- H1.2 LVL with glue-line treatment is an acceptable solution for internal framing meeting the requirements of the New Zealand Building Code B2/AS1 for Durability.
- LVL treated using LOSP Azoles as specified for H3.1 in NZS3640 Table 6.2 satisfies the minimum requirement of H1.2 and is acceptable for use in internal framing applications.

It is important that designers and specifiers are aware that the min requirements for the treatment of Engineered Timber can change as new standards and treatment technology is developed. Feel free to contact NZWOOD for clarification on any treatment requirements.

FSC & PEFC Chain of Custody Certification

NZWOOD has Forest Stewardship Council® (FSC) and Programme for the Endorsement of Forest Certification (PEFC) chain of custody certification. The certification proves that the timber NZWOOD sells meets environmentally and socially responsible timber criteria. FSC and PEFC Chain of custody systems are governed by standards that require specific documentation and procedures for handling certified wood products with the basic aim to prevent the mixing of FSC or PEFC wood with uncontrolled sources. All information relating to the path taken by products from the forest including each stage of processing, transformation, manufacturing and distribution is tracked.

FSC Chain of Custody Certification

FSC chain of custody certified products provide assurances that the wood originates from well managed or responsibly managed forests. NZWOOD provide a range of plywood, scaffolding and LVL products that are FSC Certified with a FSC Mix 70% claim. Our main supplier for these products is Juken New Zealand Ltd.

PEFC Chain of Custody Certification

PEFC differs from FSC at the forest management level, but the chains of custody are similar. The certification includes requirements for traceability and handling of PEFC certified timber. A product carrying the PEFC label means it has originated from a forest certified by a PEFC endorsed scheme and has been handled by PEFC certified organisations. NZWOOD provide a range of I-Beams and engineered timber products that are PEFC certified. Our supplier of I-Beams is Louisiana Pacific Corporation and our supplier for engineered beams is Hyne Pty Australia.

If you require further information regarding our FSC and PEFC certification please contact us at NZWOOD.





HYNE TIMBER ABN 67 009 660 995
 160 Kent St, PO Box 106
 Maryborough QLD 4650
 T: 07 4121 1211 F: 07 4122 4607
 E: maryborough@hyne.com.au
www.hyne.com.au

Producer Statement

Issued: February 2013

HYNE produce a range of Glued-laminated products (Glulam). Glulam products are produced by finger jointing and gluing shorter and small cross section timber together to make a larger cross section final product.

All HYNE Glued-laminated products are produced at the Maryborough Glulam plant and are manufactured in accordance with AS/NZS 1328.1-1998. The site operates an AS4707-2006 Chain of Custody compliant management system that covers all laminated products produced at the site as well as holding ISO9001-2006 accreditation for its manufacturing systems.

HYNE BEAM 17 products are high grade glued-laminated timber beams formed from Australian pine.

- All components are assembled using only durable, exterior grade adhesives that comply with Service Class 3 as per AS/NZS 4364-2010.
- The beams are specified as cambered (C) to 600 m radius.
- HYNE BEAM 17 is available in two grades in accordance with AS/NZS1328.1-1998. STR – Structural Grade/Appearance C and SEL –Select Grade/Appearance A.
- HYNE BEAM is available treated to H3.1
- Third party certified through the Glue Laminated Timber Association of Australia (GLTAA).

HYNE BEAM 18 products are high grade glued-laminated timber beams formed from Australian hardwoods.

- All components are assembled using only durable, exterior grade adhesives that comply with Service Class 3 as per AS/NZS 4364-2010.
- The beams are specified as cambered (C) to 600 m radius.
- HYNEBEAM 18 is manufactured from Durability Class 4 timber species and is only suitable for internal applications
- HYNEBEAM 18 is available in two grades in accordance with AS/NZS1328.1-1998. STR – Structural Grade/Appearance C and SEL –Select Grade/Appearance A.

HYNE BEAM 21 products are high grade glued-laminated timber beams formed from Australian hardwoods

- All components are assembled using only durable, exterior grade adhesives that comply with Service Class 3 as per AS/NZS 4364-2010.
- The beams are specified as cambered (C) to 600 m radius.
- HYNE BEAM 21 is manufactured from a minimum Durability Class 2 Timber species.
- HYNE BEAM 21 is available in two grades in accordance with AS/NZS1328.1-1998. STR – Structural Grade/Appearance C and SEL –Select Grade/Appearance A.
- Third party certified through the Glue Laminated Timber Association of Australia (GLTAA).

HYNE LGL44 and HYNE LGL65 are high grade glued-laminated timber beams formed from Australian pine.

- All components are assembled using only durable, exterior grade adhesives that comply with Service Class 3 as per AS/NZS 4364-2010.
- The beams are specified as straight only.
- HYNE LGL44 and HYNE LGL65 are available only in STR – Structural Grade/Appearance C as per AS/NZS1328.1-1998.
- HYNE LGL44 and HYNE LGL65 is available treated to H3.1

PROUDLY AUSTRALIAN SINCE 1882

Producer Statement

Pryda Timber Connectors

January 2012

This Producer Statement is issued by Pryda NZ to cover the use, installation and durability of PRYDA TIMBER CONNECTORS for both structural application and durability as required by the New Zealand Building Code clauses B1 & B2 respectively.

Description

The PRYDA timber connectors are manufactured from either Z275 or Z600 galvanised coil. Some brackets are also available hot dipped galvanised or stainless steel for use in certain exposed and covered situations.

Application

PRYDA timber connectors are designed for specific connections of timber to timber mostly but also to other materials such as masonry, concrete and steel. Please contact PRYDA technical service should you require assistance relating to these connectors.

Installation

The PRYDA timber connectors should be installed without damage to the finished surfaces. Storage prior to use to be in dry moisture free conditions that would not affect the future durability of the product.

Design Capacity

As timber grades vary the design capacity is derived by the verification method as with the NZBC standards NZS3603:1993 mostly dependant on the shear values of the nails and bolts in timber. Most commonly used brackets have published characteristic strengths published in our literature.

Durability

The durability of the PRYDA timber connectors is in accordance with the acceptable solutions contained in Table 4.1 and Table 4.2 of NZS3604:2011 in order to achieve a 50 year life expectancy for the connectors where applicable. Alternative solutions and direct applications are to be found else where in this publication.



4/50 Meadowbank Rd, Meadowbank, Auckland 1072, NZ
T: +649 952 0001 F: +649 528 4906 M: 6421 259 1903
www.lignumstructural.co.nz

17 March 2014

New Zealand Wood Products Ltd
PO Box 13647
Onehunga
Auckland 1643

Ref 1763: Structural review of Hyne Design V7 software for New Zealand.

I have structurally reviewed the Hyne Design software version 7.3.1.2 produced by HR Design Group Ltd in accordance with sound engineering practice and with the following standards:

AS/NZS1170:2002
NZS3603:1993, including Amendment4
NZS3604:2011

The program enables the user to design rafters, beams, bearers, joists and wall frame components for domestic applications. Timber products available are Hyne 17C, 18, 21, LGL, MGP10, MGP12; LP Building Products LPI 53-T and LPI 70-T timber I beams, generic LVL11 / 13 grades and solid radiata pine grade SG8.

The review has consisted of running a range of typical scenarios through the software. No review of the internal program logic and programming code has been undertaken.

I am satisfied that with proper use by appropriately qualified personal the results from the software will enable selection of components to comply with the structural requirements of the New Zealand Building Code, subject to correct installation in accordance with the component suppliers' requirements.

Yours faithfully

A handwritten signature in blue ink that reads "D Reid".

David Reid
STRUCTURAL ENGINEER, IPENZ Member ID 121639.



4/50 Meadowbank Rd, Meadowbank, Auckland 1072, NZ
 T: +649 952 0001 F: +649 528 4906 M: 6421 259 1903
 www.lignumstructural.co.nz

15 August 2012

Louisiana Pacific Corporation
 No 2000 - 414 Union Street
 NASHVILLE, TN, USA 37219

Ref 1505: Report on structural review of timber I beams for New Zealand market.

I have structurally reviewed the data and methodology for deriving the structural properties for Louisiana Pacific timber I beams LPI53-T, LPI70-T and LPI32. The derivation of the properties has been performed by H R Design Group Ltd, Queensland, Australia and has been done in accordance with the following standards:

- AS/NZS 4063:2010 – Characterization of Structural Timber
- ASTM D5055 - 11a Standard Specification for Establishing and Monitoring Structural Capacities of Prefabricated Wood I-Joists

Table 1: Characteristic Structural Properties of LP timber I beams

| Type | LPI 53-T | | | | LPI 70-T | | | | LPI 32 | | | |
|-------|--------------|-----------------------------------|--------------------|-------|----------------|-----------------------------------|--------------------|-------|----------------|-----------------------------------|--------------------|-------|
| | width = 53mm | | width = 70mm | | width = 63.5mm | | width = 63.5mm | | width = 63.5mm | | width = 63.5mm | |
| | Mchar | EI | GwAw | Vchar | Mchar | EI | GwAw | Vchar | Mchar | EI | GwAw | Vchar |
| Depth | kNm | x10 ⁹ Nmm ² | x10 ⁶ N | kN | kNm | x10 ⁹ Nmm ² | x10 ⁶ N | kN | kNm | x10 ⁹ Nmm ² | x10 ⁶ N | kN |
| 200 | 9.1 | 367 | 2.7 | 11.0 | 12.4 | 494 | 2.7 | 11.0 | 8.0 | 395 | 1.9 | 8.0 |
| 225 | 10.5 | 488 | 3.0 | 12.4 | 14.2 | 651 | 3.0 | 12.4 | 9.2 | 530 | 2.2 | 9.1 |
| 241 | 11.4 | 574 | 3.2 | 13.3 | 15.4 | 769 | 3.2 | 13.3 | 10.0 | 635 | 2.3 | 9.9 |
| 302 | 14.7 | 967 | 3.9 | 15.7 | 19.9 | 1286 | 4.0 | 15.7 | 12.9 | 1080 | 2.8 | 12.7 |
| 356 | 17.4 | 1412 | 4.6 | 17.7 | 23.6 | 1871 | 4.7 | 17.7 | 15.6 | 1580 | 3.3 | 14.9 |
| 406 | 19.9 | 1911 | 5.3 | 19.7 | 27 | 2528 | 5.3 | 19.7 | 18.1 | 2130 | 3.7 | 16.6 |

The structural properties shown in Table 1 are consistent with the requirements of the NZ Building Code, B1 Structure and may be used for the specific design of timber components utilising NZS 3603:1993 Timber Structures Standard. Connections may be designed using NZS3603:1993 J4 joint group properties.

David Reid
 STRUCTURAL ENGINEER, IPENZ Member ID 121639.



Hyne Design

Waiting for you on our website is the feature packed Hyne Design (HD) software, distributed in NZ by New Zealand Wood Products who are the Sole Distributors of the Hyne Timber Product Range.

HD software can specify Louisiana Pacific's Solid Start timber I-Beams for an engineered floor or rafter framing system, a range of LVL11 and LVL13 products, Hyne's 17C, 18C and 21C high strength laminated beams and the Hyne 44mm LGL Edge beam. A range of common SG8 solid timber sizes are included also for additional design scope.

NZWOOD will provide technical support and design services for these products as well as providing support with the HD software package.

Need to see more? Visit New Zealand Wood Products Limited (www.nzwoodproducts.co.nz) for a free programme download with just one click of a button.

I-Built Structural Components



LPI I-Beam

Description

I-Beams are a unique combination of timber resources, utilising advanced technology to form a structurally efficient 'I' section. Made from Douglas Fir Top & Bottom Flange and an OSB web. Components are assembled using only durable, exterior grade adhesives. I-Beam is available untreated or treated to H3.1 (LOSP) from stock. I-Beams are supplied to H2S levels which is an insecticide treatment only.

Advantages

Dimensional stability, lightweight, long spanability, elimination of mid-span blocking in floor joists.

Applications

Floor joists, long span rafters.

Section sizes:

225 x 70, 240 x 70, 300 x 53, 300 x 70, 356 x 70

Available lengths:

Up to 12m in 300mm increments.

Availability:

Readily available.



Hyne Beam 17C

Description

Hyne Beam 17C products are high grade glued-laminated timber beams formed from Australian pine, into larger rectangular sections. The Hyne Beam 17C product range is manufactured in accordance with AS1328 by Hyne in Maryborough. The Hyne Beam 17C is made from slash pine feedstock. All components are assembled using only durable, exterior grade adhesives (service class 3). The beams are specified as cambered (C) to 600 m radius. Available in structural grades (STR). Hyne Beam 17C is available treated to H3.1 (LOSP).

Advantages

Dimensional stability, long spanability, aesthetically appealing, variety of shapes and curved beam options, simple high-tech connections, termite resistance and durability (when treated), easier to handle and install than steel members, third party certified through the Glue Laminated Timber Association of Australia (GLTAA) and ISO 9002.

Applications

Roof beams, bearers, columns, floor joists, rafters, lintels, portal frames.

Section sizes:

195 x 85 up to 525 x 85, 195 x 130 up to 360 x 130

Available lengths:

Up to 11.4m in 600mm increments.

Availability:

Readily available. (65mm width available on request)



Hyne Beam 18C - for premium appearance and strength

Description

Hyne Beam 18C products are high grade glued-laminated timber beams formed from Tasmanian Oak, into larger rectangular sections. The Hyne Beam 18 product range is manufactured by Hyne in Maryborough. The Hyne Beam 18C is made from Tasmanian Oak feedstock. All components are assembled using only durable, exterior grade adhesives (service class 3). The beams are specified as cambered (C) to 600 m radius. Available in appearance / select grade (SEL). Hyne Beam 18C can only be used in internal situations.

Advantages

Dimensional stability, long spanability, aesthetically appealing, variety of shapes and curved beam options, simple high-tech connections, termite resistance and durability (when treated), easier to handle and install than steel members, third party certified through the Glue Laminated Timber Association of Australia (GLTAA) and ISO 9002.

Applications

Roof beams, bearers, floor joists, rafters, lintels, portal frames.

Section sizes:

120 x 65 - 420 x 65, 120 x 85 - 600 x 85, 120 x 130 - 600 x 130

Available lengths:

Up to 11.4m in 600mm increments.

Availability:

Special order



Hyne Beam 21C - for premium appearance and strength

Description

Hyne Beam 21C products are high grade glued-laminated timber beams formed from Australian Hardwoods, into larger rectangular sections. The Hyne Beam 21 product range is manufactured by Hyne in Maryborough. The Hyne Beam 21 is made from Queensland Hardwood feedstock. All components are assembled using only durable, exterior grade adhesives (service class 3). The beams are specified as cambered (C) to 600m radius. Available in appearance / select grade (SEL). Hyne Beam 21C can only be used in sheltered situations.

Advantages

Dimensional stability, long spanability, aesthetically appealing, variety of shapes and curved beam options, simple high-tech connections, termite resistance and durability (when treated), easier to handle and install than steel members, third party certified through the Glue Laminated Timber Association of Australia (GLTAA) and ISO 9002.

Applications

Roof beams, bearers, floor joists, rafters, lintels, portal frames.

Section sizes:

120 x 65 – 410 x 65, 120 x 85 – 600 x 85

Available lengths:

Up to 11.4m in 600mm increments.

Availability:

Special order.



Hyne LGL (Edgebeam)

Description

Hyne LGL (Edgebeam) is a high grade edge glued-laminated timber beam product assembled from finger jointed pine scantling, into deeper rectangular sections. The Hyne LGL product range is manufactured in accordance with AS1328 by Hyne in Maryborough. All components are assembled using only durable, exterior grade adhesives (service class 3). Available in a range of depths to ensure compatibility with LP I-Beams. Hyne LGL is available treated or H3.1 (LOSP).

Advantages

Dimensional stability, lightweight, long spanability, treatable to H3.1, may be nail-laminated to provide wider sections.

Applications

Floor joists, bearers, rafters, purlins, lintels.

Section sizes:

200 x 44 up to 360 x 44

Available lengths:

Up to 11.4m in 600mm increments.

Availability:

Readily available. Check with New Zealand Wood Products Ltd for the 65mm availability.



I-Built Rim (RB21, RB35, RB45)

The Rimboard is used as a perimeter board.

Treated to the level of H3.1 (LOSP) to provide a protective envelope to the floor joists.

Rimboard (RB21) ties the end of the I-Beams joists together, providing lateral stability to the floor platform. Rimboard is also used as a stiffener for I-Beams in cantilevered situations.

Rimboard (RB35/RB45) is used in situations where structural fixing is required.

I-Built Structural Components



Pryda Hardware

Pryda is a world leader and specialist in the development and manufacture of timber connections systems.

These quality fixings are used throughout our flooring design. The use of Pryda specialised hardware enables quick and simplistic installation.

pryda



I-Built LVL 11 & 13

Description

I-Built LVL 11 and 13 is laminated veneer lumber made from rotary peeled veneers, laid up with parallel grain orientation. I-Built LVL is a highly predictable, uniform lumber product because natural defects such as knots, slope of grain and splits have been removed or dispersed throughout the product. In addition, the veneer sheets are placed in a specific sequence and location within the product to maximise the potential of the stiffer and stronger veneer grades. This can be considered as an engineered configuration of the veneers. NZWOOD LVL is dimensionally stable, resists warping and twisting and is machined to consistent uniform sizes.

LVL properties are consequently superior to those of standard stress graded timber. The average of most strength characteristics is higher and the variation is significantly lower when compared to solid wood.

The structural properties of NZWOOD LVL have been determined by testing in accordance with the requirements of AS/NZS 4357.0:2005 Structural Laminated Veneer Lumber.

Advantages

Dimensionally stable, long span ability, simple high tech connections, durable when treated, easier to handle and install than steel members.

Applications

Roof beams, bearers, floor joists, rafters, lintels and portal frames.

Section sizes:

90x45 up to 610x63

Available lengths:

Up to 12m in 300mm increments.

Availability:

Readily Available

I-BUILT
LVL



I-Built 90

Description

I-Built 90 is a light weight Laminated Veneer Lumber product suitable for use in frame construction, as a lintel or a beam or joist. I-Built 90 provides a cost effective, light weight solution. The 90mm beam is designed to match New Zealand framing sizes and is manufactured by Juken New Zealand Limited (an EWPA certified mill) to meet the AS/NZS 4357:2005 manufacturing standard for LVL. I-Built 90 is FSC certified and supplied Untreated or Treated to H3.1 (LOSP).

Treated beams are designed for limited exposure to weather. Beams should not be exposed to high moisture and must be contained within a building structure protected from the weather. The 90mm beams are treated by certified treatment plants in accordance with AS/NZS 1604.2004 to meet NZS3602-2003 and achieve both a H1.2 and H3.1 treatment class. Treat end cuts and envelope breaches with a solvent based preservative.

I-Built 90 comes standard in 10.7 MPa. Other strengths are also available on request.

Advantages

Dimensionally stable, long span ability, simple high tech connections, durable when treated, easier to handle and install than steel members.

Applications

Lintels, beams.

Section sizes:

150x90, 200x90, 240x90, 300x90, 360x90, 400x90

Available lengths:

Up to 9.6m in 300mm increments.

Availability:

Readily available

I-BUILT
LVL 90

| PRODUCT NAME | PRODUCT TYPE | AVAILABILITY | PRODUCT CODE | SIZE LIST (MM) |
|-------------------------------|-----------------------------|--------------|--------------|---|
| LPI I-BEAM | LVL Flange composite I-Beam | Available | LPI | LPI 225 x 70, LPI 240 x 70, LPI 300 x 53, LPI 300 x 70, LPI 356 x 70 |
| HYNE BEAM 17C 85MM | Glued-laminated timber | Available | GL17C | 195 x 85, 230 x 85, 260 x 85, 295 x 85, 330 x 85, 360 x 85, 395 x 85, 425 x 85, 460 x 85, 495 x 85, 525 x 85, 560 x 85, 590 x 85 |
| HYNE BEAM 17C 130MM | Glued-laminated timber | Available | GL17C | 130 x 130, 165 x 130, 195 x 130, 230 x 130, 260 x 130, 295 x 130, 330 x 130, 360 x 130, 395 x 130, 425 x 130, 460 x 130, 495 x 130, 525 x 130, 560 x 130, 590 x 130 |
| HYNE BEAM 18C 65MM | Glued-laminated timber | On Request | GL18C | 120 x 65, 155 x 65, 185 x 65, 215 x 65, 240 x 65, 270 x 65, 300 x 65, 330 x 65, 360 x 65, 390 x 65, 420 x 65 |
| HYNE BEAM 18C 85MM | Glued-laminated timber | On Request | GL18C | 120 x 85, 155 x 85, 185 x 85, 215 x 85, 240 x 85, 270 x 85, 300 x 85, 330 x 85, 360 x 85, 390 x 85, 420 x 85, 450 x 85, 480 x 85, 510 x 85, 540 x 85, 570 x 85, 600 x 85 |
| HYNE BEAM 18C 130MM | Glued-laminated timber | On Request | GL18C | 120 x 130, 155 x 130, 185 x 130, 215 x 130, 240 x 130, 270 x 130, 300 x 130, 330 x 130, 360 x 130, 390 x 130, 420 x 130, 450 x 130, 480 x 130, 510 x 130, 540 x 130, 570 x 130, 600 x 130 |
| HYNE BEAM 21C 65MM | Glued-laminated timber | On Request | GL21C | 120 x 65, 155 x 65, 185 x 65, 215 x 65, 240 x 65, 280 x 65, 300 x 65, 315 x 65, 350 x 65, 380 x 65, 410 x 65 |
| HYNE BEAM 21C 85MM | Glued-laminated timber | On Request | GL21C | 120 x 85, 155 x 85, 185 x 85, 215 x 85, 240 x 85, 280 x 85, 300 x 85, 315 x 85, 350 x 85, 380 x 85, 410 x 85, 445 x 85, 475 x 85, 505 x 85, 535 x 85, 570 x 85, 600 x 85 |
| HYNE LGL 44 (EDGEBEAM) | Edge glued-laminated timber | Available | LGL | 200 x 44, 240 x 44, 300 x 44, 360 x 44 |
| HYNE LGL 65 (EDGEBEAM) | Edge glued-laminated timber | On Request | LGL | 150 x 65, 200 x 65, 240 x 65, 300 x 65, 360 x 65 |
| LVL 11 45MM | Laminated veneer lumber | Available | LVL11 | 90 x 45, 140 x 45, 190 x 45, 240 x 45, 300 x 45 |
| LVL 13 45MM | Laminated veneer lumber | Available | LVL13 | 150 x 45, 200 x 45, 240 x 45, 300 x 45, 360 x 45 |
| LVL 13 63MM | Laminated veneer lumber | Available | LVL13 | 150 x 63, 200 x 63, 240 x 63, 300 x 63, 360 x 63 |
| I-BUILT 90 | Laminated veneer lumber | Available | LVL 90mm | 150 x 90, 200 x 90, 240 x 90, 300 x 90, 360 x 90, 400 x 90 |

Structural Properties - LVL / LGL


| PRODUCT | | | HYNE LGL 44 (EDGEBEAM) | HYNE LGL 65 | HYNE BEAM 17C | HYNE BEAM 18C | HYNE BEAM 21C | I-BUILT LVL 11 | I-BUILT LVL 13 | I-BUILT 90 |
|--------------------------|----------|-----------------------|---------------------------|----------------|-------------------------|-------------------------|-------------------------|-------------------|----------------------|----------------------|
| TYPE | | | Glulam | Glulam | High strength Glulam | High strength Glulam | High strength Glulam | Structural LVL | High strength LVL | High strength LVL |
| GRADE | | | LGL | LGL | GL17 | GL18 | GL21 | LVL 11 | LVL 13 | LVL 90 |
| BENDING | f_b | MPa | 30 | 33 | 40 | 45 | 50 | 38 | 48 | 35 |
| TENSION | f_t | MPa | 16 | 16 | 20 | 25 | 25 | 26 | 33 | - |
| SHEAR | f_s | MPa | 3.7 | 4.2 | 4.2 | 5.0 | 5.0 | 5.0 | 5.3 | - |
| COMP. | f_c | MPa | 30 | 26 | 33 | 45 | 50 | 38 | 38 | - |
| MODULUS OF ELASTICITY | E | MPa | 13300 | 13300 | 16700 | 18500 | 21000 | 11000 | 13200 | 9500 |
| MODULUS OF RIDGITY | G | MPa | 890 | 900 | 1110 | 1230 | 1400 | 550 | 660 | - |
| DENSITY | | kg/ m ³ | 540 | 650 | 650 | 750 | 1000 | 570 | 570 | 520 |
| JOINT GROUP | | | JD4 | JD4 | JD4 | JD3 | JD2 | JD4 | JD4 | - |
| STRENGTH GROUP | | | SD6 | SD6 | SD5 | SD3 | SD2 | SD5 | SD5 | - |
| BEARING PERP | f_p | MPa | 10 | 10 | 13 | 19 | 23 | 10 | 10 | - |
| BEARING PARALLEL | f_l | MPa | 30 | 30 | 40 | 59 | 67 | - | - | - |
| SHEAR AT JOINTS | f_{sj} | MPa | 4.2 | 4.2 | 5.4 | 7.3 | 8.4 | 5.0 | 5.3 | - |
| TENSION PERP | f_{tp} | MPa | 0.5 | 0.5 | 0.5 | 0.6 | 0.8 | - | - | - |
| DURABILITY CLASS | | | 4 | 4 | 4 | 4 | 2 | 4 | 4 | - |

| LPI SOLID START I-BEAM | JOIST WEIGHT (KG/M) | BENDING RIGIDITY E _{1XX} (KN.M ²) | BENDING RIGIDITY E _{1YY} (KN.M ²) | TORSIONAL RIGIDITY GJ (KN.M ²) | SHEAR RIGIDITY G _{WAW} (MN) | BENDING MOMENT CAPACITY (KN.M) | MAX VERT SHEAR (KN) | END BEARING CAPACITY (KN) | INTERNAL BEARING CAPACITY (KN) |
|------------------------|---------------------|--|--|--|--------------------------------------|--------------------------------|---------------------|---------------------------|--------------------------------|
| 225 X 70 | 3.97 | 651.0 | 28.9 | 4.9 | 3.0 | 14.2 | 12.4 | 9.5 | 21.7 |
| 240 X 70 | 4.07 | 769.0 | 28.9 | 4.9 | 3.2 | 15.4 | 13.3 | 9.5 | 22.0 |
| 300 X 53 | 3.75 | 967.0 | 12.1 | 4.1 | 3.9 | 14.7 | 15.7 | 9.3 | 20.9 |
| 300 X 70 | 4.48 | 1286.0 | 28.9 | 4.9 | 4.0 | 19.9 | 15.7 | 9.5 | 22.9 |
| 356 X 70 | 4.84 | 1871.0 | 28.9 | 4.9 | 4.7 | 23.6 | 17.7 | 9.5 | 23.7 |

PLEASE NOTE:

Check with NZWOOD regarding 53mm wide I-Beams & 200 high I-Beam availability


LPI™ I-Beam Profile

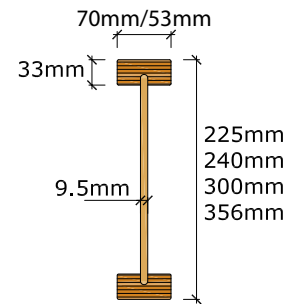

Typical Floor Construction Plan

1.1 Typical Floor Construction Plan


This is a typical floor construction plan. Please see detail numbers on the plan to locate specifics.

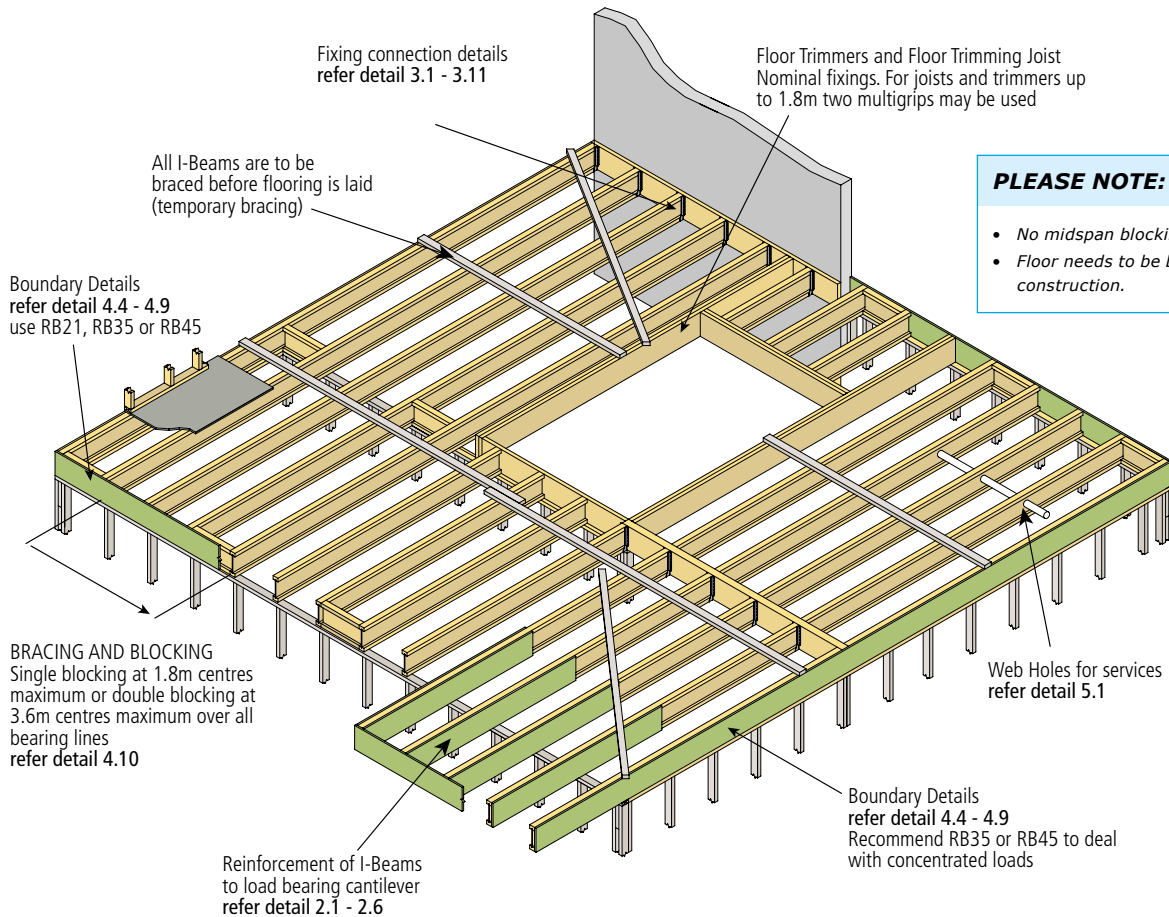

PLEASE NOTE:

- No midspan blocking required.
- Floor needs to be braced during construction.

1.2 Span Definitions Floor Joists

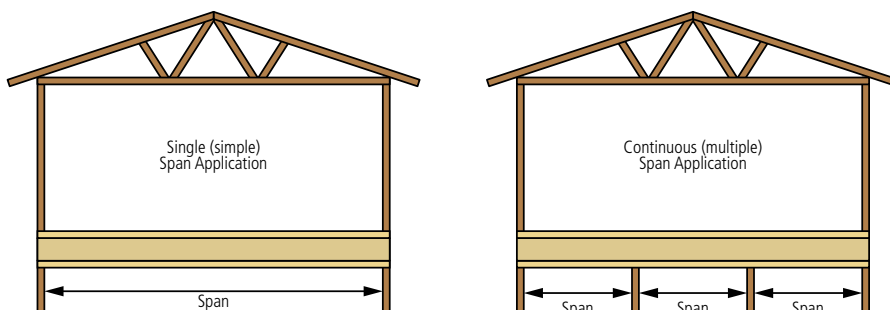

For an Engineered Timber Product member to be considered 'continuous' it shall span at least 2 adjacent spans such that span 1 is greater than or equal to $0.75 \times \text{Span 2}$.

The major span is taken from the continuous span table e.g. If span 2 = 6.0 then span 1 is greater or equal to 4.5m. Otherwise each span is to be considered 'single'.

PLEASE NOTE:

- 40% of the live load has been considered to be permanent load for assessing the long-term deflection limits for floors in general office, residential and institutional space. For other applications such as storage areas, where higher permanent loads may be expected, specific engineering design should be applied - refer to HD7 software.
- Where heavy permanent dead loads, such as water beds, or tiled floors are to be applied to the floor joist system, allowance should be made. Suitable allowances can be made by designing the floor joists at 450mm or 600mm centres but installing them at 300 or 450mm respectively.

Floor Joist Span - LPI I-Beams

Single Span

| | | I-BEAM DEPTH | 300CRS | 400CRS | 450CRS | 480CRS | 600CRS |
|---|---|--------------|--------|--------|--------|--------|--------|
| LIVE LOADS: 1.5KPA DISTRIBUTED 1.8KN CONCENTRATED | DEAD LOAD TIMBER FLOOR 40 KG/M ² | 225 x 70 | 5.5 | 5.1 | 5.0 | 4.9 | 4.6 |
| | | 240 x 70 | 5.7 | 5.3 | 5.2 | 5.1 | 4.8 |
| | | 300 x 53 | 6.1 | 5.7 | 5.5 | 5.4 | 5.1 |
| | | 300 x 70 | 6.5 | 6.1 | 5.9 | 5.8 | 5.4 |
| | | 355 x 70 | 7.2 | 6.7 | 6.5 | 6.3 | 6.0 |
| | DEAD LOAD TILED FLOOR 95 KG/M ² | 225 x 70 | 5.1 | 4.8 | 4.6 | 4.6 | 4.3 |
| | | 240 x 70 | 5.3 | 5.0 | 4.8 | 4.8 | 4.5 |
| | | 300 x 53 | 5.7 | 5.3 | 5.1 | 5.1 | 4.8 |
| | | 300 x 70 | 6.1 | 5.7 | 5.5 | 5.4 | 5.1 |
| | | 356 x 70 | 6.6 | 6.2 | 6.0 | 5.9 | 5.6 |

| | | I-BEAM DEPTH | 300CRS | 400CRS | 450CRS | 480CRS | 600CRS |
|---|---|--------------|--------|--------|--------|--------|--------|
| LIVE LOADS: 2.0KPA DISTRIBUTED 1.8KN CONCENTRATED | DEAD LOAD TIMBER FLOOR 40 KG/M ² | 225 x 70 | 5.4 | 5.1 | 4.9 | 4.8 | 4.6 |
| | | 240 x 70 | 5.6 | 5.3 | 5.1 | 5.0 | 4.8 |
| | | 300 x 53 | 6.0 | 5.6 | 5.4 | 5.4 | 4.6 |
| | | 300 x 70 | 6.4 | 6.0 | 5.8 | 5.7 | 5.4 |
| | | 356 x 70 | 7.0 | 6.6 | 6.4 | 6.3 | 5.9 |
| | DEAD LOAD TILED FLOOR 95 KG/M ² | 225 x 70 | 5.0 | 4.6 | 4.5 | 4.4 | 4.1 |
| | | 240 x 70 | 5.2 | 4.8 | 4.7 | 4.6 | 4.3 |
| | | 300 x 53 | 5.5 | 5.1 | 5.0 | 4.9 | 4.6 |
| | | 300 x 70 | 5.9 | 5.5 | 5.3 | 5.2 | 4.9 |
| | | 356 x 70 | 6.5 | 6.0 | 5.8 | 5.7 | 5.4 |

| | | I-BEAM DEPTH | 300CRS | 400CRS | 450CRS | 480CRS | 600CRS |
|---|---|--------------|--------|--------|--------|--------|--------|
| LIVE LOADS: 3.0KPA DISTRIBUTED 2.7KN CONCENTRATED | DEAD LOAD TIMBER FLOOR 40 KG/M ² | 225 x 70 | 5.0 | 4.7 | 4.5 | 4.5 | 4.2 |
| | | 240 x 70 | 5.3 | 4.9 | 4.7 | 4.6 | 4.4 |
| | | 300 x 53 | 5.6 | 5.2 | 5.0 | 4.9 | 4.7 |
| | | 300 x 70 | 6.0 | 5.5 | 5.4 | 5.3 | 4.5 |
| | | 356 x 70 | 6.6 | 6.1 | 5.9 | 5.6 | 4.5 |
| | DEAD LOAD TILED FLOOR 95 KG/M ² | 225 x 70 | 4.7 | 4.4 | 4.2 | 4.1 | 3.8 |
| | | 240 x 70 | 4.9 | 4.6 | 4.4 | 4.3 | 4.0 |
| | | 300 x 53 | 5.2 | 4.9 | 4.7 | 4.6 | 4.3 |
| | | 300 x 70 | 5.6 | 5.2 | 5.0 | 5.0 | 4.0 |
| | | 356 x 70 | 6.1 | 5.7 | 5.3 | 5.0 | 4.0 |

Continuous Span

| | | MAX JOIST SPAN (M) | | | | | |
|---|---|--------------------|--------|--------|--------|--------|--------|
| | | I-BEAM DEPTH | 300CRS | 400CRS | 450CRS | 480CRS | 600CRS |
| LIVE LOADS: 1.5KPA DISTRIBUTED 1.8KN CONCENTRATED | DEAD LOAD TIMBER FLOOR 40 KG/M ² | 225 x 70 | 6.0 | 5.6 | 5.4 | 5.3 | 5.0 |
| | | 240 x 70 | 6.3 | 5.8 | 5.6 | 5.5 | 5.2 |
| | | 300 x 53 | 6.6 | 6.2 | 6.0 | 5.9 | 5.5 |
| | | 300 x 70 | 7.1 | 6.6 | 6.4 | 6.3 | 5.9 |
| | | 356 x 70 | 7.8 | 7.3 | 7.0 | 6.9 | 6.5 |
| | DEAD LOAD TILED FLOOR 95 KG/M ² | 225 x 70 | 6.0 | 5.6 | 5.4 | 5.3 | 5.0 |
| | | 240 x 70 | 6.3 | 5.8 | 5.6 | 5.5 | 5.2 |
| | | 300 x 53 | 6.6 | 6.2 | 6.0 | 5.9 | 5.5 |
| | | 300 x 70 | 7.1 | 6.6 | 6.4 | 6.3 | 5.9 |
| | | 356 x 70 | 7.8 | 7.3 | 7.0 | 6.9 | 6.5 |

| | | I-BEAM DEPTH | 300CRS | 400CRS | 450CRS | 480CRS | 600CRS |
|---|---|--------------|--------|--------|--------|--------|--------|
| LIVE LOADS: 2.0KPA DISTRIBUTED 1.8KN CONCENTRATED | DEAD LOAD TIMBER FLOOR 40 KG/M ² | 225 x 70 | 6.1 | 5.7 | 5.5 | 5.4 | 5.1 |
| | | 240 x 70 | 6.4 | 5.9 | 5.7 | 5.6 | 5.3 |
| | | 300 x 53 | 6.8 | 6.3 | 6.1 | 6.0 | 5.6 |
| | | 300 x 70 | 7.3 | 6.7 | 6.5 | 6.4 | 6.0 |
| | | 356 x 70 | 8.0 | 7.4 | 7.2 | 7.0 | 6.6 |
| | DEAD LOAD TILED FLOOR 95 KG/M ² | 225 x 70 | 6.1 | 5.7 | 5.5 | 5.4 | 5.1 |
| | | 240 x 70 | 6.4 | 5.9 | 5.7 | 5.6 | 5.3 |
| | | 300 x 53 | 6.8 | 6.3 | 6.1 | 6.0 | 5.6 |
| | | 300 x 70 | 7.3 | 6.7 | 6.5 | 6.4 | 6.0 |
| | | 356 x 70 | 8.0 | 7.4 | 7.2 | 7.0 | 6.5 |

| | | I-BEAM DEPTH | 300CRS | 400CRS | 450CRS | 480CRS | 600CRS |
|---|---|--------------|--------|--------|--------|--------|--------|
| LIVE LOADS: 3.0KPA DISTRIBUTED 2.7KN CONCENTRATED | DEAD LOAD TIMBER FLOOR 40 KG/M ² | 225 x 70 | 5.5 | 5.1 | 4.9 | 4.9 | 4.6 |
| | | 240 x 70 | 5.7 | 5.3 | 5.2 | 5.1 | 4.8 |
| | | 300 x 53 | 6.1 | 5.6 | 5.5 | 5.4 | 5.1 |
| | | 300 x 70 | 6.5 | 6.0 | 5.9 | 5.8 | 5.2 |
| | | 356 x 70 | 7.2 | 6.6 | 6.4 | 6.3 | 5.2 |
| | DEAD LOAD TILED FLOOR 95 KG/M ² | 225 x 70 | 5.5 | 5.1 | 4.9 | 4.9 | 4.5 |
| | | 240 x 70 | 5.7 | 5.3 | 5.2 | 5.1 | 4.5 |
| | | 300 x 53 | 6.1 | 5.6 | 5.5 | 5.4 | 5.1 |
| | | 300 x 70 | 6.5 | 6.0 | 5.9 | 5.8 | 4.7 |
| | | 356 x 70 | 7.2 | 6.6 | 6.3 | 5.9 | 4.7 |

PLEASE NOTE:

Dead Load floor mass is assumed to consist of 20mm J-Ply or 20mm Strand floor linings. For additional floor lining types (I.e. Fibre Cement underlays or Aerated Concrete systems please refer to the Hyne Design Software or contact NZWOOD Products for more information.

PLEASE NOTE:

These span tables provide maximum member spans up to 100% of the recommended capacity. For a premium floor or rafter system with minimal deflection, it is recommended that spans should be restricted to 85% of the maximum allowed.



Floor Joist Span - Hyne LGL 44mm

Single Span

| | | MAX JOIST SPAN (M) | | | | |
|---|---|--------------------|--------|--------|--------|--------|
| | | LGL SIZE | 400CRS | 450CRS | 480CRS | 600CRS |
| LIVE LOADS: 1.5KPA DISTRIBUTED 1.8KN CONCENTRATED | DEAD LOAD TIMBER FLOOR 40 KG/M ² | 200 x 44 | 4.6 | 4.4 | 4.4 | 4.1 |
| | | 245 x 44 | 5.3 | 5.2 | 5.1 | 4.8 |
| | | 300 x 44 | 6.2 | 6.0 | 5.9 | 5.6 |
| | | 360 x 44 | 7.1 | 6.9 | 6.8 | 6.4 |
| | DEAD LOAD TILED FLOOR 95 KG/M ² | 200 x 44 | 4.2 | 4.0 | 4.0 | 3.7 |
| | | 245 x 44 | 4.9 | 4.8 | 4.7 | 4.5 |
| | | 300 x 44 | 5.7 | 5.6 | 5.5 | 5.2 |
| | | 360 x 44 | 6.6 | 6.4 | 6.3 | 6.0 |

| | | MAX JOIST SPAN (M) | | | | |
|---|---|--------------------|--------|--------|--------|--------|
| | | LGL SIZE | 400CRS | 450CRS | 480CRS | 600CRS |
| LIVE LOADS: 2.0KPA DISTRIBUTED 1.8KN CONCENTRATED | DEAD LOAD TIMBER FLOOR 40 KG/M ² | 200 x 44 | 4.5 | 4.3 | 4.3 | 4.0 |
| | | 245 x 44 | 5.2 | 5.1 | 5.0 | 4.8 |
| | | 300 x 44 | 6.0 | 5.9 | 5.8 | 5.5 |
| | | 360 x 44 | 6.9 | 6.7 | 6.6 | 6.3 |
| | DEAD LOAD TILED FLOOR 95 KG/M ² | 200 x 44 | 4.0 | 3.9 | 3.8 | 3.5 |
| | | 245 x 44 | 4.8 | 4.7 | 4.6 | 4.3 |
| | | 300 x 44 | 5.6 | 5.4 | 5.3 | 5.1 |
| | | 360 x 44 | 6.4 | 6.2 | 6.1 | 5.8 |

| | | MAX JOIST SPAN (M) | | | | |
|---|---|--------------------|--------|--------|--------|--------|
| | | LGL SIZE | 400CRS | 450CRS | 480CRS | 600CRS |
| LIVE LOADS: 3.0KPA DISTRIBUTED 2.7KN CONCENTRATED | DEAD LOAD TIMBER FLOOR 40 KG/M ² | 200 x 44 | 4.1 | 4.0 | 3.9 | 3.6 |
| | | 245 x 44 | 4.9 | 4.7 | 4.7 | 4.4 |
| | | 300 x 44 | 5.7 | 5.5 | 5.4 | 5.1 |
| | | 360 x 44 | 6.5 | 6.3 | 6.2 | 5.9* |
| | DEAD LOAD TILED FLOOR 95 KG/M ² | 200 x 44 | 3.8 | 3.6 | 3.6 | 3.3 |
| | | 245 x 44 | 4.6 | 4.5 | 4.4 | 4.1 |
| | | 300 x 44 | 5.3 | 5.2 | 5.1 | 4.8 |
| | | 360 x 44 | 6.1 | 5.9 | 5.8 | 5.5* |

* Denotes member must have min 65mm bearing at the 2 supports

PLEASE NOTE:

These span tables provide maximum member spans up to 100% of the recommended capacity. For a premium floor or rafter system with minimal deflection, it is recommended that spans should be restricted to 85% of the maximum allowed.



Continuous Span

| | | MAX JOIST SPAN (M) | | | | |
|---|---|--------------------|--------|--------|--------|--------|
| | | LGL SIZE | 400CRS | 450CRS | 480CRS | 600CRS |
| LIVE LOADS: 1.5KPA DISTRIBUTED 1.8KN CONCENTRATED | DEAD LOAD TIMBER FLOOR 40 KG/M ² | 200 x 44 | 5.0 | 4.8 | 4.8 | 4.5 |
| | | 245 x 44 | 5.8 | 5.7 | 5.6 | 5.3 |
| | | 300 x 44 | 6.8 | 6.6 | 6.5 | 6.1 |
| | | 360 x 44 | 7.8 | 7.6 | 7.4 | 7.0 |
| | DEAD LOAD TILED FLOOR 95 KG/M ² | 200 x 44 | 5.0 | 4.8 | 4.8 | 4.5 |
| | | 245 x 44 | 5.8 | 5.7 | 5.6 | 5.3 |
| | | 300 x 44 | 6.8 | 6.6 | 6.5 | 6.1 |
| | | 360 x 44 | 7.8 | 7.6 | 7.4 | 7.0# |

Denotes member must have min 85mm bearing at the internal support

| | | LGL SIZE | 400CRS | 450CRS | 480CRS | 600CRS |
|--|----------|---|---|----------|--------|--------|
| | | LIVE LOADS: 2.0KPA DISTRIBUTED 1.8KN CONCENTRATED | DEAD LOAD TIMBER FLOOR 40 KG/M ² | 200 x 44 | 5.1 | 4.9 |
| 245 x 44 | 5.9 | | | 5.8 | 5.7 | 5.3 |
| 300 x 44 | 6.9 | | | 6.7 | 6.6 | 6.2 |
| 360 x 44 | 7.9 | | | 7.7 | 7.6 | 7.2# |
| DEAD LOAD TILED FLOOR 95 KG/M ² | 200 x 44 | | 5.1 | 4.9 | 4.9 | 4.5 |
| | 245 x 44 | | 5.9 | 5.8 | 5.7 | 5.3 |
| | 300 x 44 | | 6.9 | 6.7 | 6.6 | 6.2# |
| | 360 x 44 | | 7.9* | 7.7# | 7.6# | 7.2# |

* Denotes member must have min 65mm bearing at the internal support

Denotes member must have min 85mm bearing at the internal support

| | | LGL SIZE | 400CRS | 450CRS | 480CRS | 600CRS |
|--|----------|---|---|----------|--------|--------|
| | | LIVE LOADS: 3.0KPA DISTRIBUTED 2.7KN CONCENTRATED | DEAD LOAD TIMBER FLOOR 40 KG/M ² | 200 x 44 | 4.6 | 4.5 |
| 245 x 44 | 5.3 | | | 5.2 | 5.1 | 4.8# |
| 300 x 44 | 6.2 | | | 6.1* | 6.0# | 5.6# |
| 360 x 44 | 7.2# | | | 6.9# | 6.8# | 6.1# |
| DEAD LOAD TILED FLOOR 95 KG/M ² | 200 x 44 | | 4.6 | 4.5 | 4.4 | 3.9 |
| | 245 x 44 | | 5.3 | 5.2 | 5.1* | 4.8# |
| | 300 x 44 | | 6.2* | 6.1# | 6.0# | 5.4# |
| | 360 x 44 | | 7.2# | 6.9# | 6.7# | 5.4# |

* Denotes member must have min 65mm bearing at the internal support

Denotes member must have min 85mm bearing at the internal support

PLEASE NOTE:

These span tables provide maximum member spans up to 100% of the recommended capacity. For a premium floor or rafter system with minimal deflection, it is recommended that spans should be restricted to 85% of the maximum allowed.



Floor Joist Span - I-Built LVL 11

Single Span

| | | MAX JOIST SPAN (M) | | | | |
|---|---|--------------------|--------|--------|--------|--------|
| | | LVL11 SIZE | 400CRS | 450CRS | 480CRS | 600CRS |
| LIVE LOADS: 1.5KPA DISTRIBUTED 1.8KN CONCENTRATED | DEAD LOAD TIMBER FLOOR 40 KG/M ² | 140 x 45 | 2.9 | 2.8 | 2.7 | 2.6 |
| | | 190 x 45 | 4.2 | 4.0 | 3.9 | 3.7 |
| | | 240 x 45 | 5.0 | 4.9 | 4.8 | 4.5 |
| | | 300 x 45 | 6.0 | 5.8 | 5.7 | 5.4 |
| | DEAD LOAD TILED FLOOR 95 KG/M ² | 140 x 45 | 2.8 | 2.7 | 2.6 | 2.4 |
| | | 190 x 45 | 3.8 | 3.6 | 3.6 | 3.3 |
| | | 240 x 45 | 4.7 | 4.5 | 4.5 | 4.2 |
| | | 300 x 45 | 5.5 | 5.4 | 5.3 | 5.0 |

| | | MAX JOIST SPAN (M) | | | | |
|---|---|--------------------|--------|--------|--------|--------|
| | | LVL11 SIZE | 400CRS | 450CRS | 480CRS | 600CRS |
| LIVE LOADS: 2.0KPA DISTRIBUTED 1.8KN CONCENTRATED | DEAD LOAD TIMBER FLOOR 40 KG/M ² | 140 x 45 | 2.9 | 2.8 | 2.7 | 2.6 |
| | | 190 x 45 | 4.1 | 3.9 | 3.8 | 3.6 |
| | | 240 x 45 | 4.9 | 4.8 | 4.7 | 4.5 |
| | | 300 x 45 | 5.8 | 5.6 | 5.6 | 5.3 |
| | DEAD LOAD TILED FLOOR 95 KG/M ² | 140 x 45 | 2.7 | 2.6 | 2.5 | 2.3 |
| | | 190 x 45 | 3.6 | 3.5 | 3.4 | 3.2 |
| | | 240 x 45 | 4.5 | 4.4 | 4.3 | 4.0 |
| | | 300 x 45 | 5.4 | 5.2 | 5.1 | 4.9 |

| | | MAX JOIST SPAN (M) | | | | |
|---|---|--------------------|--------|--------|--------|--------|
| | | LVL11 SIZE | 400CRS | 450CRS | 480CRS | 600CRS |
| LIVE LOADS: 3.0KPA DISTRIBUTED 2.7KN CONCENTRATED | DEAD LOAD TIMBER FLOOR 40 KG/M ² | 140 x 45 | 2.7 | 2.6 | 2.6 | 2.4 |
| | | 190 x 45 | 3.7 | 3.6 | 3.5 | 3.3 |
| | | 240 x 45 | 4.6 | 4.5 | 4.4 | 4.1 |
| | | 300 x 45 | 5.4 | 5.3 | 5.2 | 4.9 |
| | DEAD LOAD TILED FLOOR 95 KG/M ² | 140 x 45 | 2.5 | 2.4 | 2.4 | 2.2 |
| | | 190 x 45 | 3.4 | 3.3 | 3.2 | 3.0 |
| | | 240 x 45 | 4.3 | 4.1 | 4.0 | 3.8 |
| | | 300 x 45 | 5.1 | 5.0 | 4.9 | 4.6 |

Continuous Span

| | | MAX JOIST SPAN (M) | | | | |
|---|---|--------------------|--------|--------|--------|--------|
| | | LVL11 SIZE | 400CRS | 450CRS | 480CRS | 600CRS |
| LIVE LOADS: 1.5KPA DISTRIBUTED 1.8KN CONCENTRATED | DEAD LOAD TIMBER FLOOR 40 KG/M ² | 140 x 45 | 3.7 | 3.4 | 3.3 | 3.1 |
| | | 190 x 45 | 4.6 | 4.5 | 4.4 | 4.2 |
| | | 240 x 45 | 5.5 | 5.4 | 5.3 | 5.0 |
| | | 300 x 45 | 6.5 | 6.3 | 6.2 | 5.9 |
| | DEAD LOAD TILED FLOOR 95 KG/M ² | 140 x 45 | 3.7 | 3.6 | 3.5 | 3.2 |
| | | 190 x 45 | 4.6 | 4.5 | 4.4 | 4.2 |
| | | 240 x 45 | 5.5 | 5.4 | 5.3 | 5.0 |
| | | 300 x 45 | 6.5 | 6.3 | 6.2 | 5.9 |

| | | MAX JOIST SPAN (M) | | | | |
|---|---|--------------------|--------|--------|--------|--------|
| | | LVL11 SIZE | 400CRS | 450CRS | 480CRS | 600CRS |
| LIVE LOADS: 2.0KPA DISTRIBUTED 1.8KN CONCENTRATED | DEAD LOAD TIMBER FLOOR 40 KG/M ² | 140 x 45 | 3.5 | 3.2 | 3.2 | 3.0 |
| | | 190 x 45 | 4.7 | 4.6 | 4.5 | 4.2 |
| | | 240 x 45 | 5.6 | 5.4 | 5.4 | 5.1 |
| | | 300 x 45 | 6.6 | 6.4 | 6.3 | 6.0 |
| | DEAD LOAD TILED FLOOR 95 KG/M ² | 140 x 45 | 3.7 | 3.5 | 3.4 | 3.2 |
| | | 190 x 45 | 4.7 | 4.6 | 4.5 | 4.2 |
| | | 240 x 45 | 5.6 | 5.4 | 5.4 | 5.1 |
| | | 300 x 45 | 6.6 | 6.4 | 6.3 | 6.0 |

| | | MAX JOIST SPAN (M) | | | | |
|---|---|--------------------|--------|--------|--------|--------|
| | | LVL11 SIZE | 400CRS | 450CRS | 480CRS | 600CRS |
| LIVE LOADS: 3.0KPA DISTRIBUTED 2.7KN CONCENTRATED | DEAD LOAD TIMBER FLOOR 40 KG/M ² | 140 x 45 | 3.3 | 3.2 | 3.1 | 2.9 |
| | | 190 x 45 | 4.2 | 4.1 | 4.1 | 3.8 |
| | | 240 x 45 | 5.1 | 4.9 | 4.8 | 4.6 |
| | | 300 x 45 | 6.0 | 5.8 | 5.7 | 5.4 |
| | DEAD LOAD TILED FLOOR 95 KG/M ² | 140 x 45 | 3.3 | 3.2 | 3.1 | 2.9 |
| | | 190 x 45 | 4.2 | 4.1 | 4.1 | 3.8 |
| | | 240 x 45 | 5.1 | 4.9 | 4.8 | 4.6 |
| | | 300 x 45 | 6.0 | 5.8 | 5.7 | 5.4 |

PLEASE NOTE:

These span tables provide maximum member spans up to 100% of the recommended capacity. For a premium floor or rafter system with minimal deflection, it is recommended that spans should be restricted to 85% of the maximum allowed.



Single Span

| | | MAX JOIST SPAN (M) | | | | |
|---|---|--------------------|--------|--------|--------|--------|
| | | LVL13 SIZE | 400CRS | 450CRS | 480CRS | 600CRS |
| LIVE LOADS: 1.5KPA DISTRIBUTED 1.8KN CONCENTRATED | DEAD LOAD TIMBER FLOOR 40 KG/M ² | 150 x 45 | 3.3 | 3.1 | 3.1 | 2.9 |
| | | 200 x 45 | 4.6 | 4.4 | 4.3 | 4.1 |
| | | 240 x 45 | 5.3 | 5.1 | 5.0 | 4.8 |
| | | 300 x 45 | 6.2 | 6.1 | 6.0 | 5.6 |
| | | 360 x 45 | 7.2 | 7.0 | 6.8 | 6.5 |
| | | 150 x 63 | 3.8 | 3.5 | 3.5 | 3.3 |
| | | 200 x 63 | 5.0 | 4.9 | 4.8 | 4.5 |
| | | 240 x 63 | 5.7 | 5.6 | 5.5 | 5.2 |
| | | 300 x 63 | 6.8 | 6.6 | 6.5 | 6.1 |
| | 360 x 63 | 7.8 | 7.6 | 7.5 | 7.0 | |
| | DEAD LOAD TILED FLOOR 95 KG/M ² | 150 x 45 | 3.2 | 3.1 | 3.0 | 2.8 |
| | | 200 x 45 | 4.2 | 4.1 | 4.0 | 3.7 |
| | | 240 x 45 | 4.9 | 4.8 | 4.7 | 4.5 |
| | | 300 x 45 | 5.8 | 5.6 | 5.5 | 5.3 |
| | | 360 x 45 | 6.6 | 6.4 | 6.3 | 6.0 |
| | | 150 x 63 | 3.9 | 3.7 | 3.7 | 3.4 |
| | | 200 x 63 | 5.0 | 4.8 | 4.8 | 4.5 |
| | | 240 x 63 | 5.7 | 5.5 | 5.5 | 5.2 |
| 300 x 63 | | 6.7 | 6.5 | 6.4 | 6.1 | |
| 360 x 63 | 7.6 | 7.4 | 7.3 | 7.0 | | |
| LIVE LOADS: 2.0KPA DISTRIBUTED 1.8KN CONCENTRATED | DEAD LOAD TIMBER FLOOR 40 KG/M ² | 150 x 45 | 3.3 | 3.1 | 3.1 | 2.9 |
| | | 200 x 45 | 4.5 | 4.4 | 4.3 | 4.0 |
| | | 240 x 45 | 5.2 | 5.0 | 5.0 | 4.7 |
| | | 300 x 45 | 6.1 | 5.9 | 5.8 | 5.5 |
| | | 360 x 45 | 6.9 | 6.7 | 6.7 | 6.3 |
| | | 150 x 63 | 3.8 | 3.5 | 3.5 | 3.3 |
| | | 200 x 63 | 5.1 | 4.9 | 4.9 | 4.6 |
| | | 240 x 63 | 5.8 | 5.7 | 5.6 | 5.3 |
| | | 300 x 63 | 6.9 | 6.7 | 6.6 | 6.2 |
| | 360 x 63 | 7.9 | 7.7 | 7.6 | 7.2 | |
| | DEAD LOAD TILED FLOOR 95 KG/M ² | 150 x 45 | 3.1 | 2.9 | 2.9 | 2.7 |
| | | 200 x 45 | 4.1 | 3.9 | 3.8 | 3.6 |
| | | 240 x 45 | 4.8 | 4.6 | 4.6 | 4.3 |
| | | 300 x 45 | 5.6 | 5.5 | 5.4 | 5.1 |
| | | 360 x 45 | 6.4 | 6.2 | 6.1 | 5.8 |
| | | 150 x 63 | 3.7 | 3.6 | 3.5 | 3.3 |
| | | 200 x 63 | 4.8 | 4.7 | 4.6 | 4.4 |
| | | 240 x 63 | 5.5 | 5.4 | 5.3 | 5.0 |
| 300 x 63 | | 6.5 | 6.3 | 6.2 | 5.9 | |
| 360 x 63 | 7.4 | 7.2 | 7.1 | 6.8 | | |
| LIVE LOADS: 3.0KPA DISTRIBUTED 2.7KN CONCENTRATED | DEAD LOAD TIMBER FLOOR 40 KG/M ² | 150 x 45 | 3.1 | 3.0 | 2.9 | 2.7 |
| | | 200 x 45 | 4.2 | 4.0 | 3.9 | 3.7 |
| | | 240 x 45 | 4.8 | 4.7 | 4.6 | 4.4 |
| | | 300 x 45 | 5.7 | 5.5 | 5.5 | 5.2 |
| | | 360 x 45 | 6.5 | 6.3 | 6.2 | 5.9 |
| | | 150 x 63 | 3.7 | 3.5 | 3.5 | 3.3 |
| | | 200 x 63 | 4.6 | 4.5 | 4.4 | 4.1 |
| | | 240 x 63 | 5.3 | 5.1 | 5.0 | 4.8 |
| | | 300 x 63 | 6.2 | 6.1 | 6.0 | 5.6 |
| | 360 x 63 | 7.2 | 7.0 | 6.8 | 6.5 | |
| | DEAD LOAD TILED FLOOR 95 KG/M ² | 150 x 45 | 2.9 | 2.7 | 2.7 | 2.5 |
| | | 200 x 45 | 3.8 | 3.7 | 3.6 | 3.3 |
| | | 240 x 45 | 4.5 | 4.4 | 4.3 | 4.0 |
| | | 300 x 45 | 5.3 | 5.2 | 5.1 | 4.9 |
| | | 360 x 45 | 6.1 | 5.9 | 5.9 | 5.6 |
| | | 150 x 63 | 3.5 | 3.4 | 3.3 | 3.1 |
| | | 200 x 63 | 4.6 | 4.5 | 4.4 | 4.1 |
| | | 240 x 63 | 5.3 | 5.1 | 5.0 | 4.8 |
| 300 x 63 | | 6.2 | 6.0 | 6.0 | 5.6 | |
| 360 x 63 | 7.1 | 6.9 | 6.8 | 6.5 | | |

PLEASE NOTE:

These span tables provide maximum member spans up to 100% of the recommended capacity. For a premium floor or rafter system with minimal deflection, it is recommended that spans should be restricted to 85% of the maximum allowed.



Floor Joist Span - I-Built LVL 13

Continuous Span

| | | MAX JOIST SPAN (M) | | | | |
|---|---|--------------------|--------|--------|--------|--------|
| | | LVL13 SIZE | 400CRS | 450CRS | 480CRS | 600CRS |
| LIVE LOADS: 1.5KPA DISTRIBUTED 1.8KN CONCENTRATED | DEAD LOAD TIMBER FLOOR 40 KG/M ² | 150 x 45 | 4.0 | 3.8 | 3.7 | 3.5 |
| | | 200 x 45 | 5.0 | 4.9 | 4.8 | 4.5 |
| | | 240 x 45 | 5.8 | 5.6 | 5.5 | 5.2 |
| | | 300 x 45 | 6.8 | 6.6 | 6.5 | 6.2 |
| | | 360 x 45 | 7.8 | 7.6 | 7.5 | 7.1 |
| | | 150 x 63 | 4.4 | 4.3 | 4.2 | 4.0 |
| | | 200 x 63 | 5.5 | 5.3 | 5.2 | 4.9 |
| | | 240 x 63 | 6.3 | 6.1 | 6.0 | 5.7 |
| | | 300 x 63 | 7.4 | 7.2 | 7.1 | 6.7 |
| | 360 x 63 | 8.5 | 8.3 | 8.2 | 7.7 | |
| | DEAD LOAD TILED FLOOR 95 KG/M ² | 150 x 45 | 4.0 | 3.9 | 3.9 | 3.6 |
| | | 200 x 45 | 5.0 | 4.9 | 4.8 | 4.5 |
| | | 240 x 45 | 5.8 | 5.6 | 5.5 | 5.2 |
| | | 300 x 45 | 6.8 | 6.6 | 6.5 | 6.2 |
| | | 360 x 45 | 7.8 | 7.6 | 7.5 | 7.1 |
| | | 150 x 63 | 4.4 | 4.3 | 4.2 | 4.0 |
| | | 200 x 63 | 5.5 | 5.3 | 5.2 | 4.9 |
| | | 240 x 63 | 6.3 | 6.1 | 6.0 | 5.7 |
| 300 x 63 | | 7.4 | 7.2 | 7.1 | 6.7 | |
| 360 x 63 | 8.5 | 8.3 | 8.2 | 7.7 | | |

| | | MAX JOIST SPAN (M) | | | | |
|---|---|--------------------|--------|--------|--------|--------|
| | | LVL13 SIZE | 400CRS | 450CRS | 480CRS | 600CRS |
| LIVE LOADS: 2.0KPA DISTRIBUTED 1.8KN CONCENTRATED | DEAD LOAD TIMBER FLOOR 40 KG/M ² | 150 x 45 | 4.1 | 3.8 | 3.7 | 3.5 |
| | | 200 x 45 | 5.1 | 5.0 | 4.9 | 4.6 |
| | | 240 x 45 | 5.9 | 5.7 | 5.6 | 5.3 |
| | | 300 x 45 | 7.0 | 6.7 | 6.6 | 6.3 |
| | | 360 x 45 | 8.0 | 7.7 | 7.6 | 7.2 |
| | | 150 x 63 | 4.5 | 4.3 | 4.2 | 4.0 |
| | | 200 x 63 | 5.6 | 5.4 | 5.3 | 5.0 |
| | | 240 x 63 | 6.4 | 6.2 | 6.1 | 5.8 |
| | | 300 x 63 | 7.6 | 7.3 | 7.2 | 6.8 |
| | 360 x 63 | 8.7 | 8.4 | 8.3 | 7.8 | |
| | DEAD LOAD TILED FLOOR 95 KG/M ² | 150 x 45 | 4.1 | 4.0 | 3.9 | 3.6 |
| | | 200 x 45 | 5.1 | 5.0 | 4.9 | 4.6 |
| | | 240 x 45 | 5.9 | 5.7 | 5.6 | 5.3 |
| | | 300 x 45 | 7.0 | 6.7 | 6.6 | 6.3 |
| | | 360 x 45 | 8.0 | 7.7 | 7.6 | 7.2 |
| | | 150 x 63 | 4.5 | 4.3 | 4.3 | 4.0 |
| | | 200 x 63 | 5.6 | 5.4 | 5.3 | 5.0 |
| | | 240 x 63 | 6.4 | 6.2 | 6.1 | 5.8 |
| 300 x 63 | | 7.6 | 7.3 | 7.2 | 6.8 | |
| 360 x 63 | 8.7 | 8.4 | 8.3 | 7.8 | | |

| | | MAX JOIST SPAN (M) | | | | |
|---|---|--------------------|--------|--------|--------|--------|
| | | LVL13 SIZE | 400CRS | 450CRS | 480CRS | 600CRS |
| LIVE LOADS: 3.0KPA DISTRIBUTED 2.7KN CONCENTRATED | DEAD LOAD TIMBER FLOOR 40 KG/M ² | 150 x 45 | 3.7 | 3.6 | 3.5 | 3.3 |
| | | 200 x 45 | 4.6 | 4.5 | 4.4 | 4.2 |
| | | 240 x 45 | 5.3 | 5.1 | 5.1 | 4.8 |
| | | 300 x 45 | 6.3 | 6.1 | 6.0 | 5.7 |
| | | 360 x 45 | 7.2 | 7.0 | 6.9 | 6.5 |
| | | 150 x 63 | 4.0 | 3.9 | 3.9 | 3.6 |
| | | 200 x 63 | 5.0 | 4.9 | 4.8 | 4.5 |
| | | 240 x 63 | 5.8 | 5.6 | 5.5 | 5.2 |
| | | 300 x 63 | 6.8 | 6.6 | 6.5 | 6.2 |
| | 360 x 63 | 7.8 | 7.6 | 7.5 | 7.1 | |
| | DEAD LOAD TILED FLOOR 95 KG/M ² | 150 x 45 | 3.7 | 3.6 | 3.5 | 3.3 |
| | | 200 x 45 | 4.6 | 4.5 | 4.4 | 4.2 |
| | | 240 x 45 | 5.3 | 5.1 | 5.1 | 4.8 |
| | | 300 x 45 | 6.3 | 6.1 | 6.0 | 5.7 |
| | | 360 x 45 | 7.2 | 7.0 | 6.9 | 6.5 |
| | | 150 x 63 | 4.0 | 3.9 | 3.9 | 3.6 |
| | | 200 x 63 | 5.0 | 4.9 | 4.8 | 4.5 |
| | | 240 x 63 | 5.8 | 5.6 | 5.5 | 5.2 |
| 300 x 63 | | 6.8 | 6.6 | 6.5 | 6.2 | |
| 360 x 63 | 7.8 | 7.6 | 7.5 | 7.1 | | |

PLEASE NOTE:

These span tables provide maximum member spans up to 100% of the recommended capacity. For a premium floor or rafter system with minimal deflection, it is recommended that spans should be restricted to 85% of the maximum allowed.





Cantilever Floor Joist Details

2.1 Cantilever Outrigger Deck/Balcony Detail

2.0


Durable joist outriggers and edge trimmers to suit balcony requirements

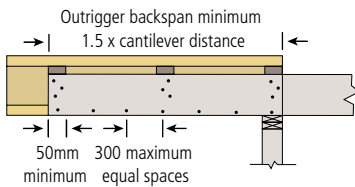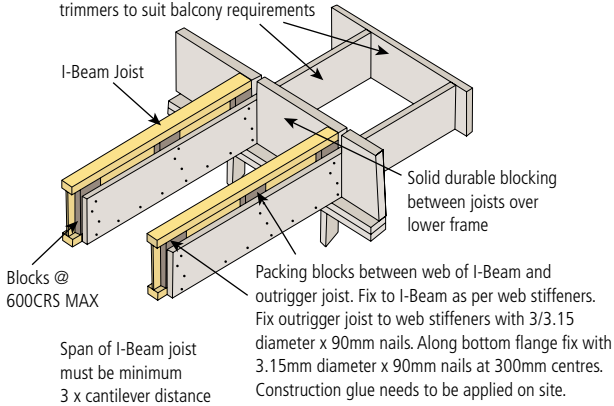

2.2 Cantilever Method (M1)

2.1

If bottom plate is outside the requirements of NZS 3604 Table 8.17 and requires support use min 70 x 35 MSG8 bridge member on top of the bottom flange, fixed using 2/75 x 3.15 nails through web. Nail and glue Rimboard to this bridge member.

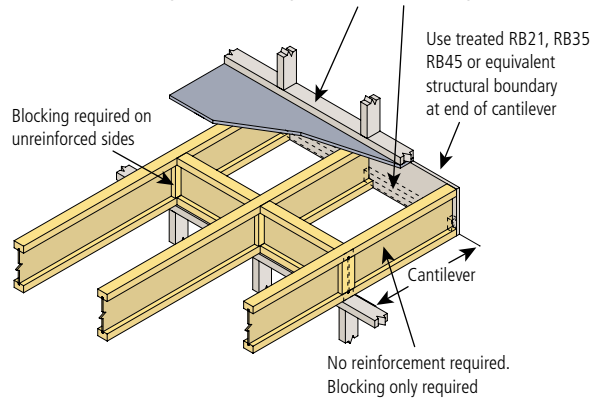

PLEASE NOTE:

M1 - no reinforcement required.

M2 - load-bearing cantilever reinforced one side.


M3 - load-bearing cantilever reinforced both sides.

Cantilever distance allowable for I-Beam sizes to be verified by reference to the I-Beam span tables or HD software.

2.3 Cantilever Method 2 (M2) Detail

2.2


If bottom plate is outside the requirements of NZS 3604 Table 8.17 and requires support use min 70 x 35 MSG8 bridge member on top of the bottom flange, fixed using 2/75 x 3.15 nails through web. Nail and glue Rimboard to this bridge member

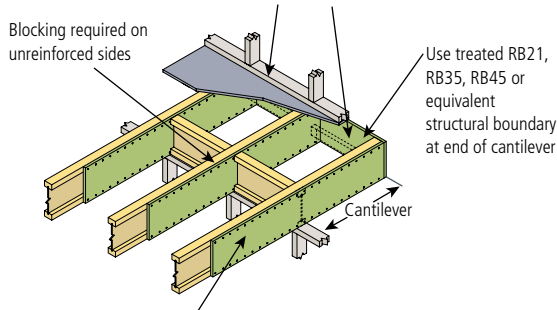

2.4 Cantilever Method 3 (M3)


2.3

If bottom plate is outside the requirements of NZS 3604 Table 8.17 and requires support use 70 x 35 MSG8 bridge member on top of the bottom flange, fixed using 2/75 x 3.15 nails through web. Nail and glue Rimboard to this bridge member.

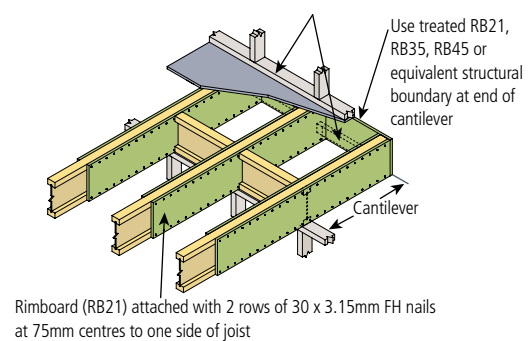


2.5 Brick Edge Cantilever

2.4

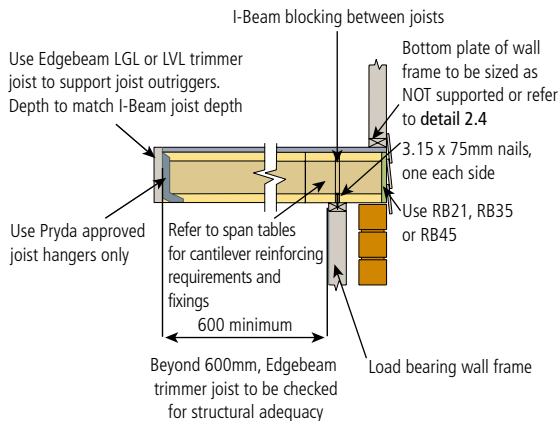

2.6 Load Bearing Cantilever Example

2.5

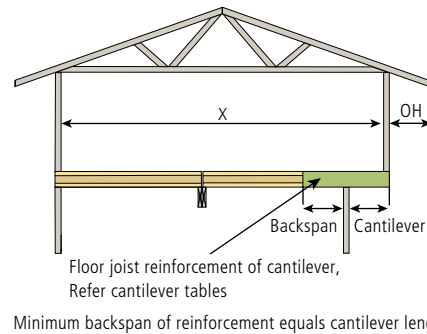

$$\text{Roof load width (RLW)} = \left(\frac{X}{2} + OH \right)$$

Refers to superseded detail number

Cantilever Floor Joist Details / Fixing Details

Span Table – Load Bearing Cantilever - 1.5 kPa Floor

| MAXIMUM CANTILEVER | I-BEAM SOLUTION | LIGHT WEIGHT ROOFING - (UP TO 20KG/M ²) | | | | | | | | | HEAVY WEIGHT ROOFING - (UP TO 60KG/M ²) | | | | | | | | |
|--------------------------|-----------------|--|-----|-----|-----|-----|-----|-----|-----|-----|--|-----|-----|-----|-----|-----|-----|-----|-----|
| | | ROOF LOAD WIDTH, RLW (M) | | | | | | | | | ROOF LOAD WIDTH, RLW (M) | | | | | | | | |
| | | 4.0 | | | 6.0 | | | 8.0 | | | 2.0 | | | 4.0 | | | 6.0 | | |
| FLOOR JOIST SPACINGS(MM) | | 300 | 450 | 600 | 300 | 450 | 600 | 300 | 450 | 600 | 300 | 450 | 600 | 300 | 450 | 600 | 300 | 450 | 600 |
| 450MM | LPI 225 | M1 | M1 | M2 | M1 | M2 | M3 | M1 | M2 | - | M1 | M1 | M2 | M1 | M2 | - | M1 | - | - |
| | LPI 240 | M1 | M1 | M1 | M1 | M1 | M2 | M1 | M1 | M3 | M1 | M1 | M1 | M1 | M1 | M2 | M1 | M2 | - |
| | LPI 300 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M2 |
| | LPI 356 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M2 |
| 750MM | LPI 225 | M1 | M1 | M2 | M1 | M2 | - | M1 | M3 | - | M1 | M1 | M2 | M1 | M2 | - | M1 | - | - |
| | LPI 240 | M1 | M1 | M1 | M1 | M1 | M2 | M1 | M1 | M3 | M1 | M1 | M1 | M1 | M1 | M2 | M1 | M2 | - |
| | LPI 300 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M2 |
| | LPI 356 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M2 |
| 900MM | LPI 225 | M1 | M1 | M3 | M1 | M2 | - | M1 | M3 | - | M1 | M1 | M3 | M1 | M3 | - | M2 | - | - |
| | LPI 240 | M1 | M1 | M1 | M1 | M1 | M2 | M1 | M1 | M3 | M1 | M1 | M1 | M1 | M1 | M3 | M1 | M2 | - |
| | LPI 300 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M2 |
| | LPI 356 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M2 |
| 1200MM | LPI 225 | M1 | M3 | - | M2 | - | - | M3 | - | - | M1 | M3 | - | M2 | - | - | - | - | - |
| | LPI 240 | M1 | M1 | M3 | M1 | M2 | - | M1 | M3 | - | M1 | M1 | M3 | M1 | M3 | - | M2 | - | - |
| | LPI 300 | M1 | M1 | M1 | M1 | M1 | M2 | M1 | M1 | M2 | M1 | M1 | M1 | M1 | M1 | M2 | M1 | M2 | M3 |
| | LPI 356 | M1 | M1 | M1 | M1 | M1 | M2 | M1 | M1 | M2 | M1 | M1 | M1 | M1 | M1 | M2 | M1 | M2 | M3 |

Span Table – Load Bearing Cantilever 0.5 kPa Snow Load

| MAXIMUM CANTILEVER | I-BEAM SOLUTION | LIGHT WEIGHT ROOFING - (UP TO 20KG/M ²) | | | | | | | | | HEAVY WEIGHT ROOFING - (UP TO 60KG/M ²) | | | | | | | | |
|--------------------------|-----------------|--|-----|-----|-----|-----|-----|-----|-----|-----|--|-----|-----|-----|-----|-----|-----|-----|-----|
| | | ROOF LOAD WIDTH, RLW (M) | | | | | | | | | ROOF LOAD WIDTH, RLW (M) | | | | | | | | |
| | | 4.0 | | | 6.0 | | | 8.0 | | | 2.0 | | | 4.0 | | | 6.0 | | |
| FLOOR JOIST SPACINGS(MM) | | 300 | 450 | 600 | 300 | 450 | 600 | 300 | 450 | 600 | 300 | 450 | 600 | 300 | 450 | 600 | 300 | 450 | 600 |
| 450MM | LPI 225 | M1 | M1 | M2 | M1 | M2 | M3 | M1 | M2 | - | M1 | M1 | M2 | M1 | M2 | - | M1 | - | - |
| | LPI 240 | M1 | M1 | M1 | M1 | M1 | M2 | M1 | M1 | M3 | M1 | M1 | M1 | M1 | M1 | M2 | M1 | M2 | - |
| | LPI 300 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M2 |
| | LPI 356 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M2 |
| 750MM | LPI 225 | M1 | M1 | M2 | M1 | M2 | - | M1 | M3 | - | M1 | M1 | M2 | M1 | M2 | - | M1 | - | - |
| | LPI 240 | M1 | M1 | M1 | M1 | M1 | M2 | M1 | M1 | M3 | M1 | M1 | M1 | M1 | M1 | M2 | M1 | M2 | - |
| | LPI 300 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M2 |
| | LPI 356 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M2 |
| 900MM | LPI 225 | M1 | M1 | M3 | M1 | M2 | - | M1 | M3 | - | M1 | M1 | M3 | M1 | M3 | - | M2 | - | - |
| | LPI 240 | M1 | M1 | M1 | M1 | M1 | M2 | M1 | M2 | M3 | M1 | M1 | M1 | M1 | M1 | M3 | M1 | M2 | - |
| | LPI 300 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M2 |
| | LPI 356 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M1 | M2 |
| 1200MM | LPI 225 | M1 | M3 | - | M2 | - | - | M3 | - | - | M1 | M3 | - | M2 | - | - | - | - | - |
| | LPI 240 | M1 | M1 | M3 | M1 | M2 | - | M1 | M3 | - | M1 | M1 | M3 | M1 | M3 | - | M2 | - | - |
| | LPI 300 | M1 | M1 | M1 | M1 | M1 | M2 | M1 | M1 | M3 | M1 | M1 | M1 | M1 | M1 | M2 | M1 | M2 | M3 |
| | LPI 356 | M1 | M1 | M1 | M1 | M1 | M2 | M1 | M1 | M3 | M1 | M1 | M1 | M1 | M1 | M2 | M1 | M2 | M3 |

PLEASE NOTE:

These span tables provide maximum member spans up to 100% of the recommended capacity. For a premium floor or rafter system with minimal deflection, it is recommended that spans should be restricted to 85% of the maximum allowed.



Hanger Fixings




Pryda I-Beam hangers have been engineered to provide support for I-Beams, Hyne LGL and 17C beams in domestic and commercial applications. The hangers are fully compatible with I-Beams, Hyne LGL and 17C beams and are suitable for any support configuration. The product has been developed in accordance with the relevant New Zealand Building Standards and the design capacities are verified by a rigorous testing program. We recommend that installation of I-Beams, Hyne LGL and 17C beams with the Pryda I-Beam hangers is conducted in accordance with the construction guide.

PLEASE NOTE:

- You must check the capacity of all hangers and connections for your particular application.
- Minimum 3mm/maximum 6mm clearance between beams. Contact between beams may cause squeaks.
- Ensure fasteners are selected to meet the durability requirements of NZS 3604:2011.
- Use the correct nails, screws and nail plates, following installation instructions.
- Builder also to refer to the I-Built supplementary site guide.


3.1 Joist Hanger Connection Types

4.0

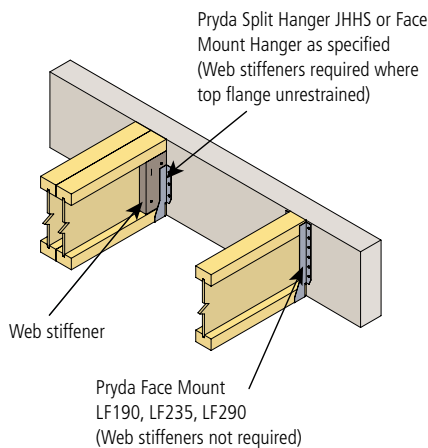


3.2 I-Beam Fixed to Steel Beam with Face Mount Hanger

4.1

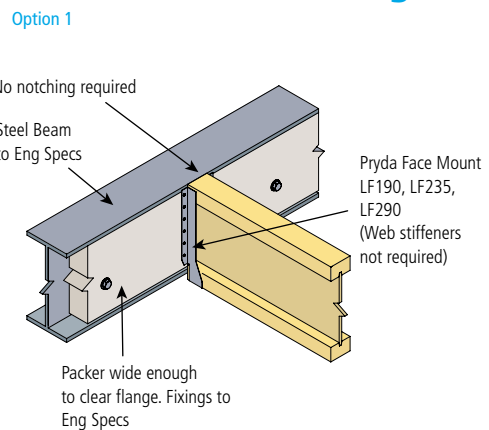


3.3 I-Beam Fixed to Steel Beam with Face Mount Hanger

4.2

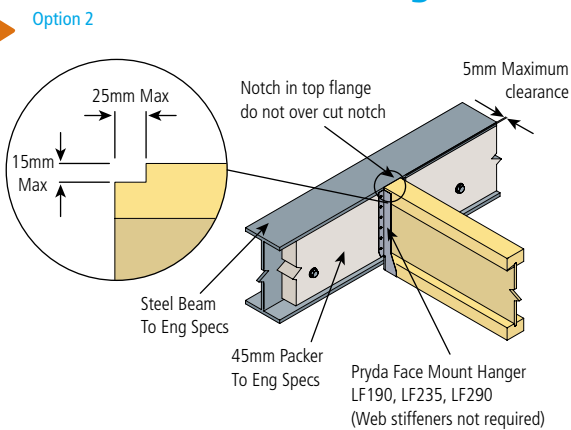


3.4 Joist Connection to Steel Beam

4.3

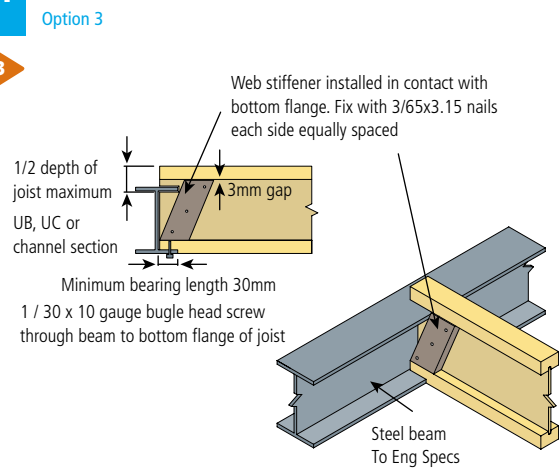

3.5 Joist to Trimmer Connection

4.4

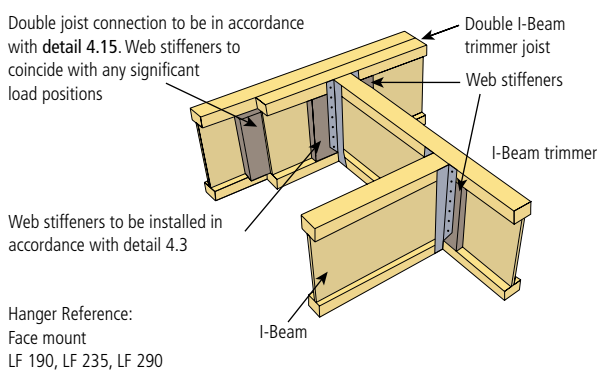


Refers to superseded detail number

3.6 End Bearing

A


4.5

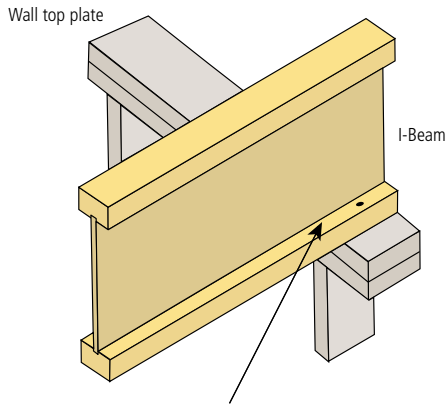

Nail to top plate with minimum 75 x 3.15mm nails One nail on each side through the flange.
Min End Bearing: 38mm
Min int Bearing: 63mm

Detail Over the Top Plate at Mid Support

B

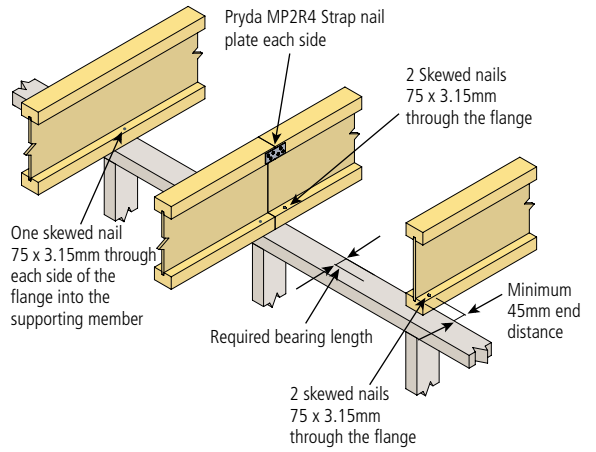


3.7 Fixing Requirements for Face Mount Hangers


A

4.6


IMPORTANT
Minimum gap 3mm
between beam and I-Beam




B



C

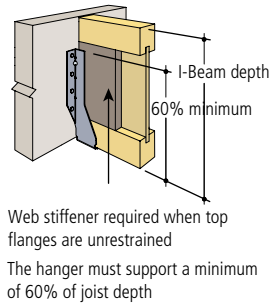

D

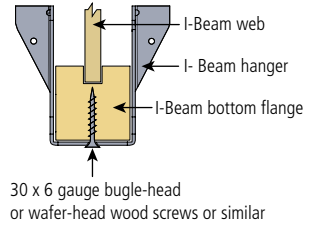


PLEASE NOTE:

Minimum 3mm/maximum 6mm clearance between beams. Contact between beams may cause squeaks.


3.8 Skew Angle Hanger

4.7

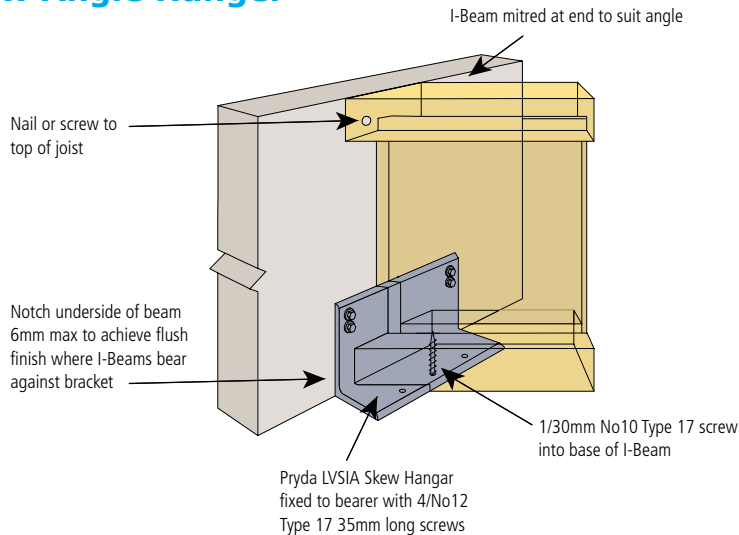

3.9 45° Skew Angle Hanger Fixing

4.8

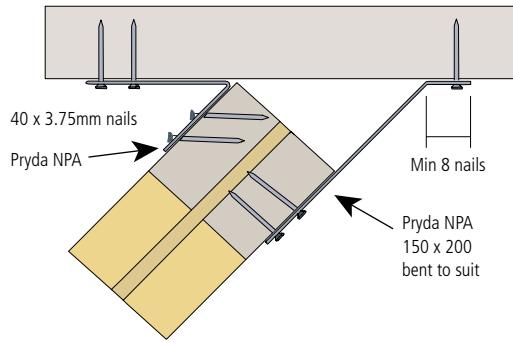


Left or right orientation based on view from the supported I-Beam

Hanger Reference:
NPA & NPA 150 x 200
Refer to New Zealand Wood Products Ltd for alternative solution

3.10 45° Skew Angle Hanger Fixing


4.9

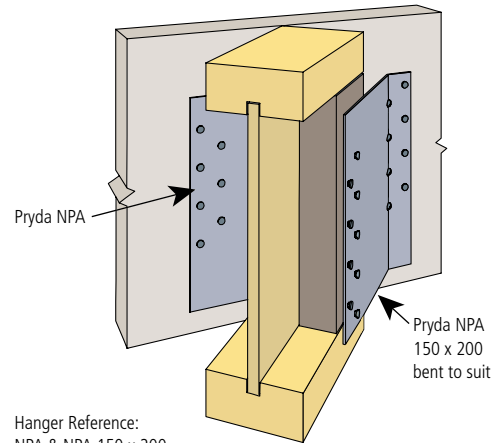


Hanger Reference:
NPA & NPA 150 x 200
Refer to New Zealand Wood Products Ltd for alternative solution

3.11 Hyne LGL & 17c Hanger Fixing

4.10

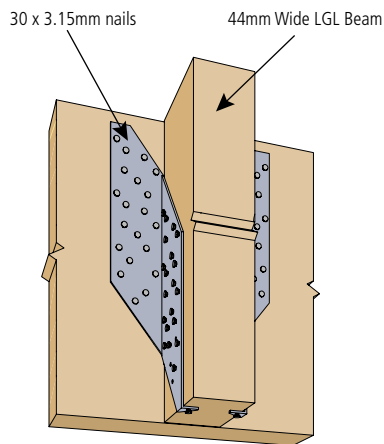

Hanger Reference:
JHHS

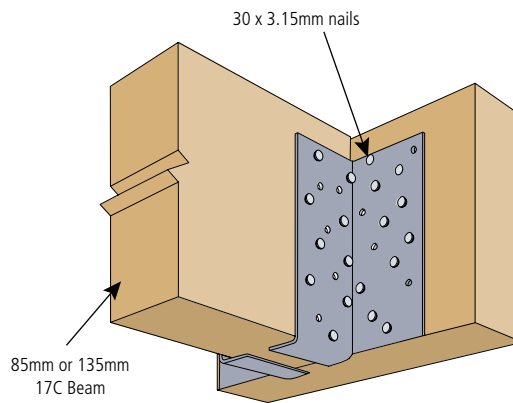


Hanger Reference:
JHSS 212
JHSS 275
JHSS 401

Internal Bracing & Web Stiffener Detail


4.1 Bracing Wall Tie Down

5.0

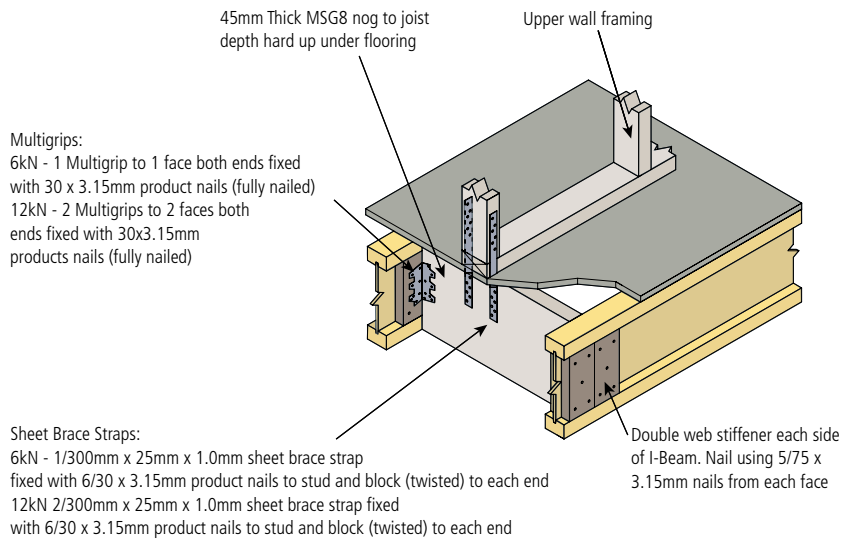

4.2 Non-Loadbearing Wall Parallel

5.1

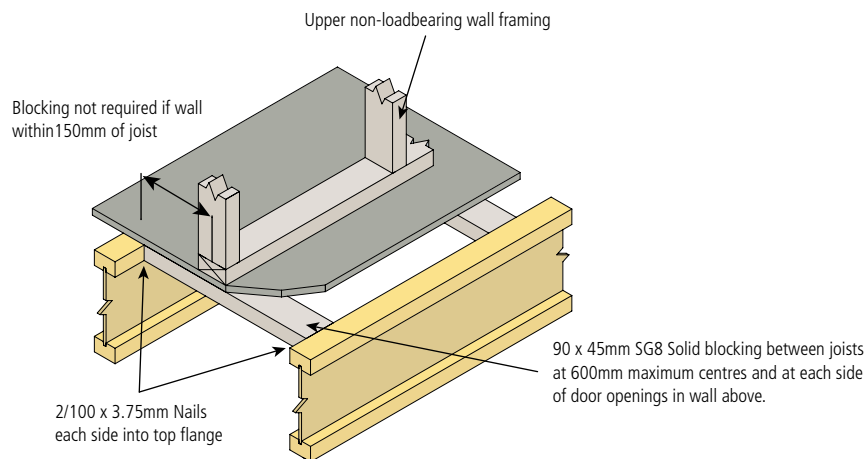


4.3 Web Stiffener Detail

5.2


PLEASE NOTE:

- Web stiffeners to be used at all concentrated loads and at supports where specified.
- Web stiffener size 70 x 30mm.
- Web stiffeners are required to prevent buckling of I-Beam web. This occurs when loads are being transferred to the end of the beam.

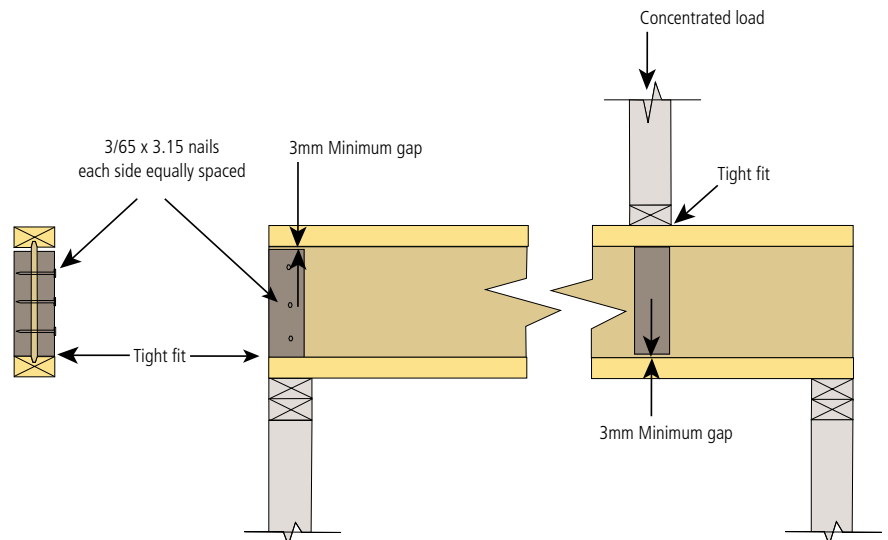


Boundary Details


4.4 Rimboard External Wall Bracing Fixing

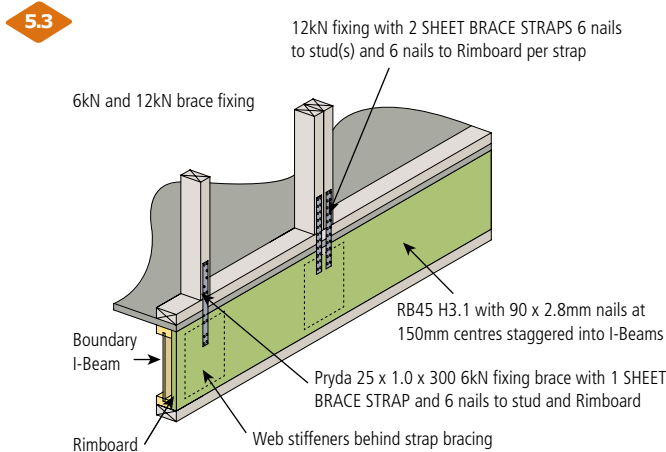


4.5 Rimboard End Joist

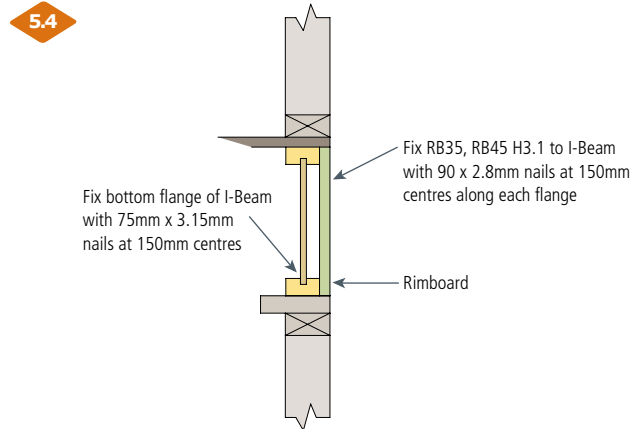

4.6 Load Bearing I-Beam & Rimboard/Boundary

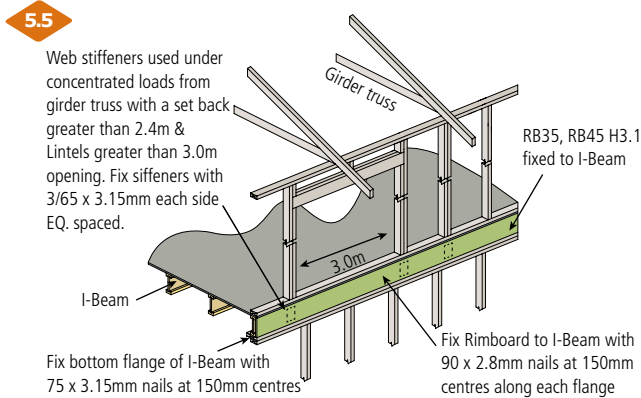

4.7 Rimboard Joining

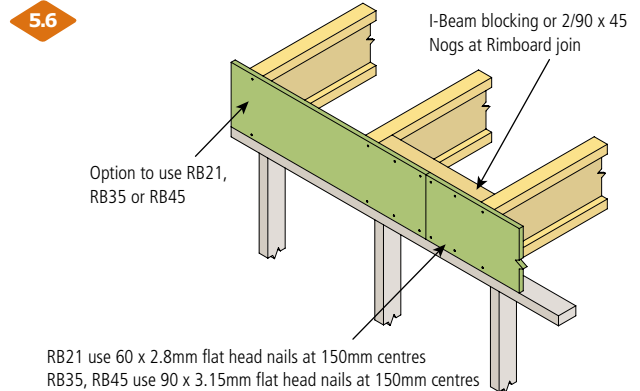


PLEASE NOTE:

- Avoid using wide section timber.
- All Rimboards are treated to H3.1 (LOSP)
- Refer to NZS3602.2003 for treatment details.


PLEASE NOTE:

- Blunt nail ends to avoid splitting of flanges.
- All Rimboards are treated to H3.1 (LOSP)
- Refer to NZS3602.2003 for treatment details.

4.8 Concentrated Load at Jam Studs or Posts

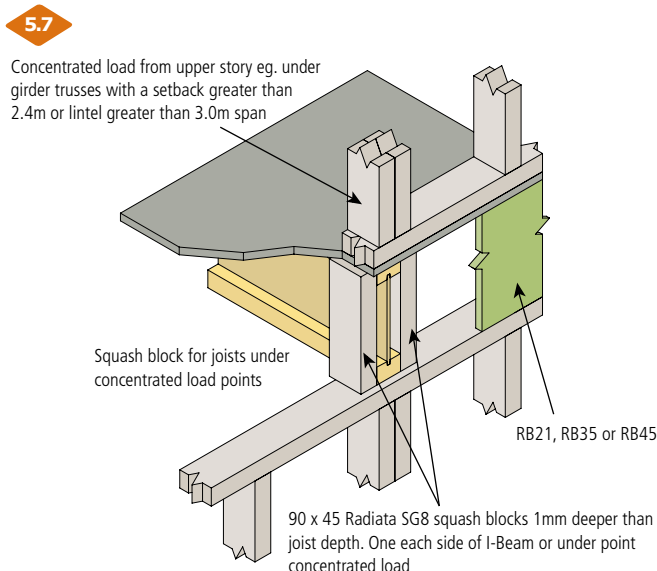

4.9 Rimboard Fixing to I-Beam - Transferring Bracing Load From Wall Above

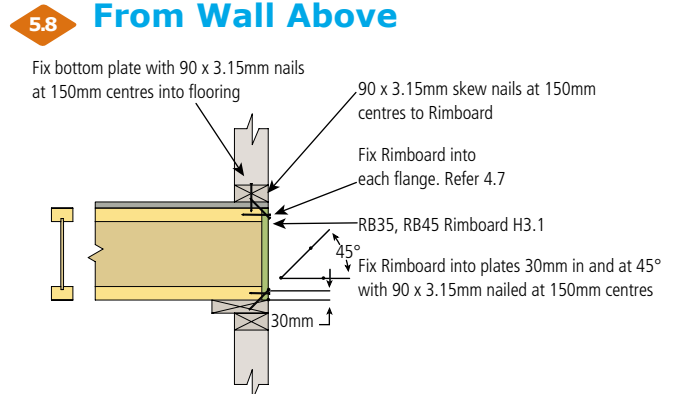

PLEASE NOTE:


- Where 6kN and 12kN tie down bracing straps are required - these are to be fixed to manufactures specifications in addition to the fixing shown above.
- Other wall fixings to NZS3604 requirements.

Refers to superseded detail number

Bracing and Blocking & Apron Roof Detail

4.10 Bracing and Blocking

5.9

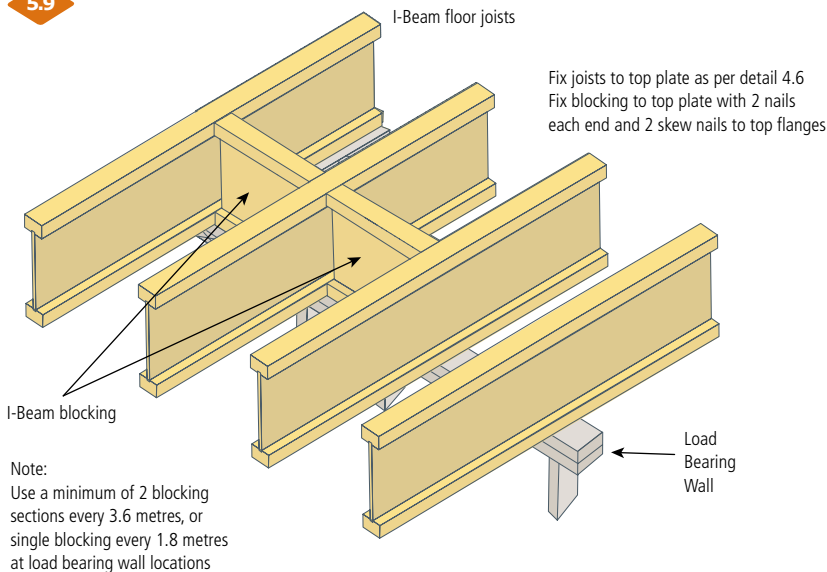

PLEASE NOTE:

BRACE BLOCKING FOR WIND AND EARTHQUAKE
Bracing of the floor is required to transfer bracing forces from the upper level to the lower level.


This is achieved by providing lateral restraint to the floor. Where the forces are parallel with the joist this is adequate with the longitudinal shear capacity of the joists.

For forces perpendicular to the joist, brace blocking is required. This can be achieved by two blocking panels at 3.6m centres or one blocking panel at 1.8m centres along bearing and bracing walls.

Along the external wall use the Rimboard.

4.11 Apron Roof Detail With Joist Taper Cut

5.10

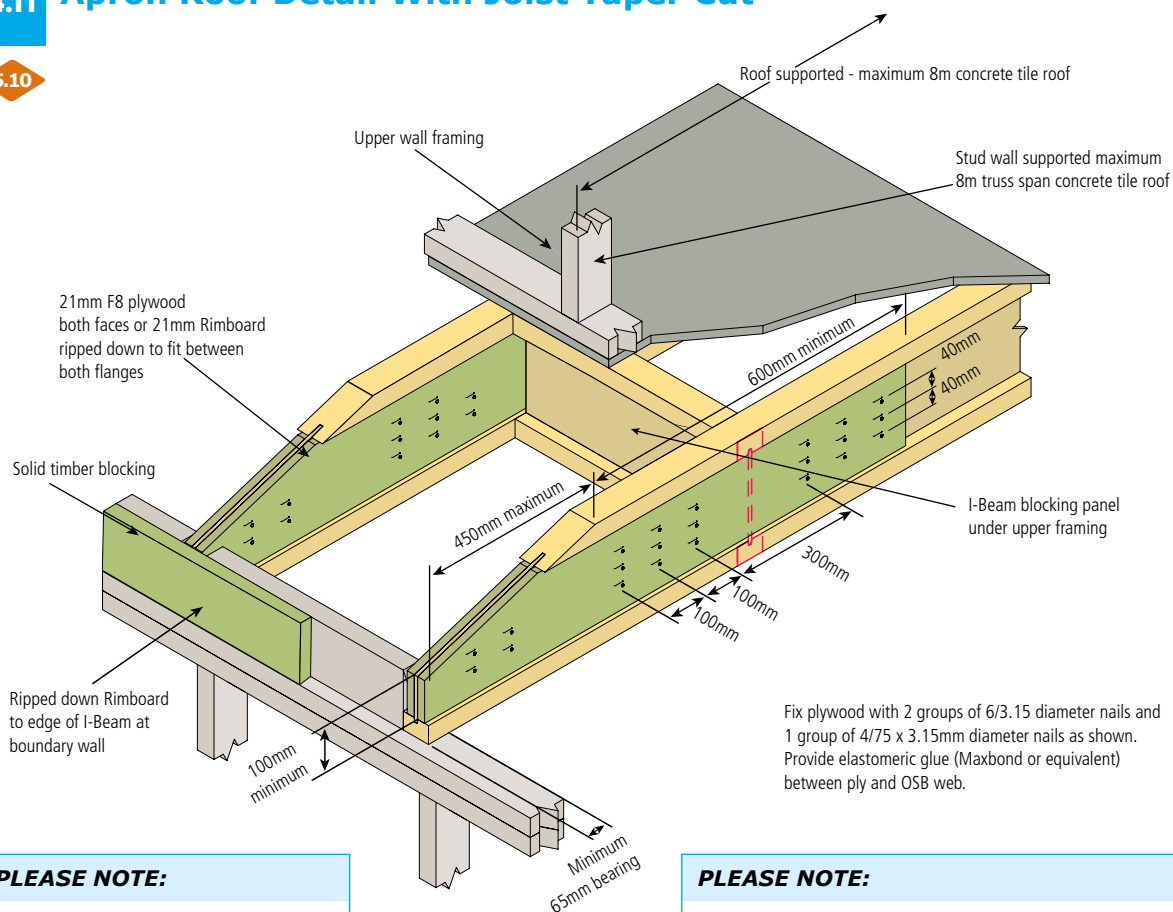

PLEASE NOTE:

Refer to NZWOOD's additional Tech Note "Taper Cuts" regarding LP I-Joists maximum reaction capacities at support locations also.


PLEASE NOTE:

- Double joist required under load bearing studs supporting upstairs lintels.
- For lintel spans greater than 900mm, Engineering design will be required.
- Engineered design is required for I-Beams supporting girder trusses.
- Rimboard will need to be ripped down on site to fit between flanges.
- For I-Beam size selection refer to HD software for walls loaded on joists.

J-Ply Floor Fixing – Details


4.12 Fixing Strandfloor/Particle Board Flooring

5.11

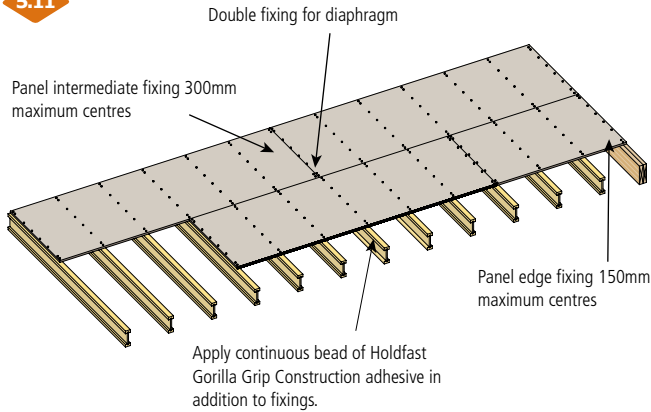

4.13 Fixing Plywood Flooring Panels

5.12

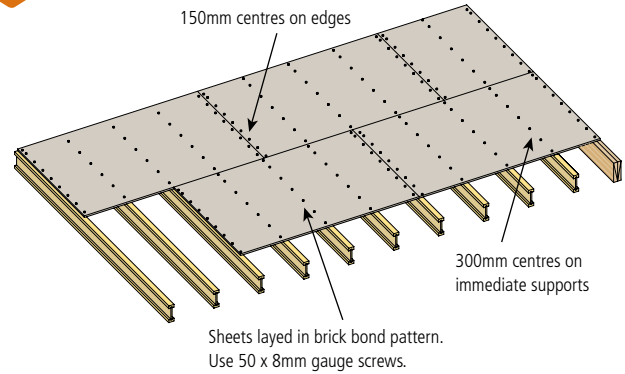

PLEASE NOTE:

- Timber nogs or tongue and groove joint is required at sheet edges.
- Lay sheets in brick - bond pattern.


| PARTICLE BOARD FIXING OPTIONS | | FIXING CENTRES (MM) | |
|--|-----------|---------------------|---------------|
| I-BEAM JOISTS | SIZE | ENDS | INTERMEDIATES |
| Annular grooved galvanised particle board flooring nails | 60mm | 150 | 300 |
| Galvanised jolt head nails | 60mm | 150 | 300 |
| Type 17 countersunk head self drilling screws | 45mm x 8g | 150 | 300 |

| PLYWOOD FIXING OPTIONS | | FIXING CENTRES (MM) | |
|--|-------------|---------------------|---------------|
| I-BEAM JOISTS | SIZE | ENDS | INTERMEDIATES |
| Galvanised Flat head Nails | 60mm x 2.8g | 150 | 300 |
| Galvanised screw self drilling or counter sunk | 60mm x 2.8g | 150 | 300 |

4.14 Floor Fixing Detail

5.13

Refer to flooring manufacturer's literature required edge distances for fastening of sheet joint to LPI™ joists

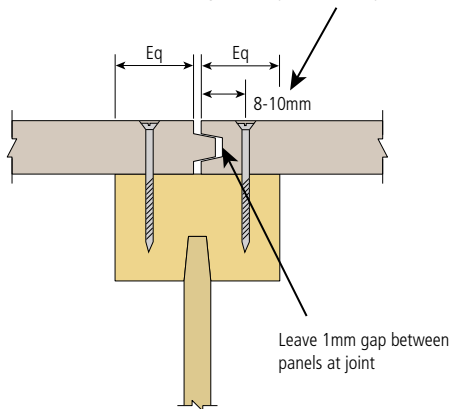

PLEASE NOTE:

- NZWOOD recommends the use of tongue and groove floor sheets.
- Floor sheets should be installed staggered, with all edges parallel to the joists bearing on the joist.
- Screw floor sheets to each joist. The use of properly applied adequate adhesive will increase floor performance.
- All four floor sheet corners should preferably be screwed.
- Leave 10mm gap between sheet edges and walls.
- Unless otherwise specified by flooring manufacturer, apply fasteners with Min 8-10mm gap from edge of sheet.




strandfloor®


Refers to superceded detail number

Double Beam Connections

4.15 Double I-Beam Connection

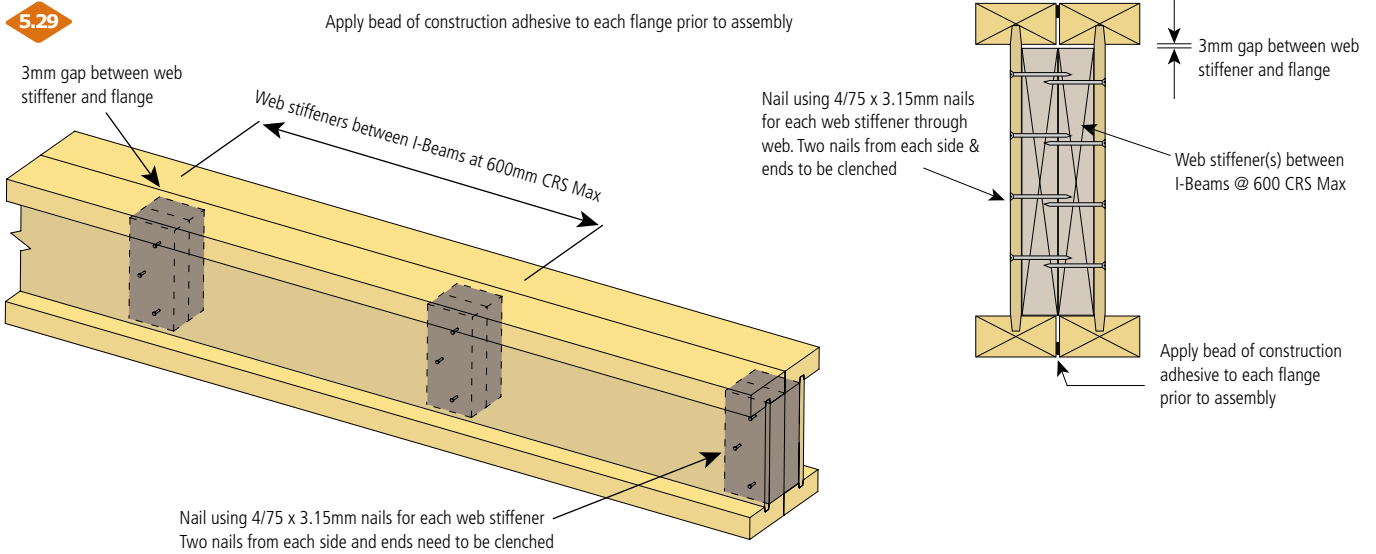

4.16 Double Hyne LGL & LVL Connections

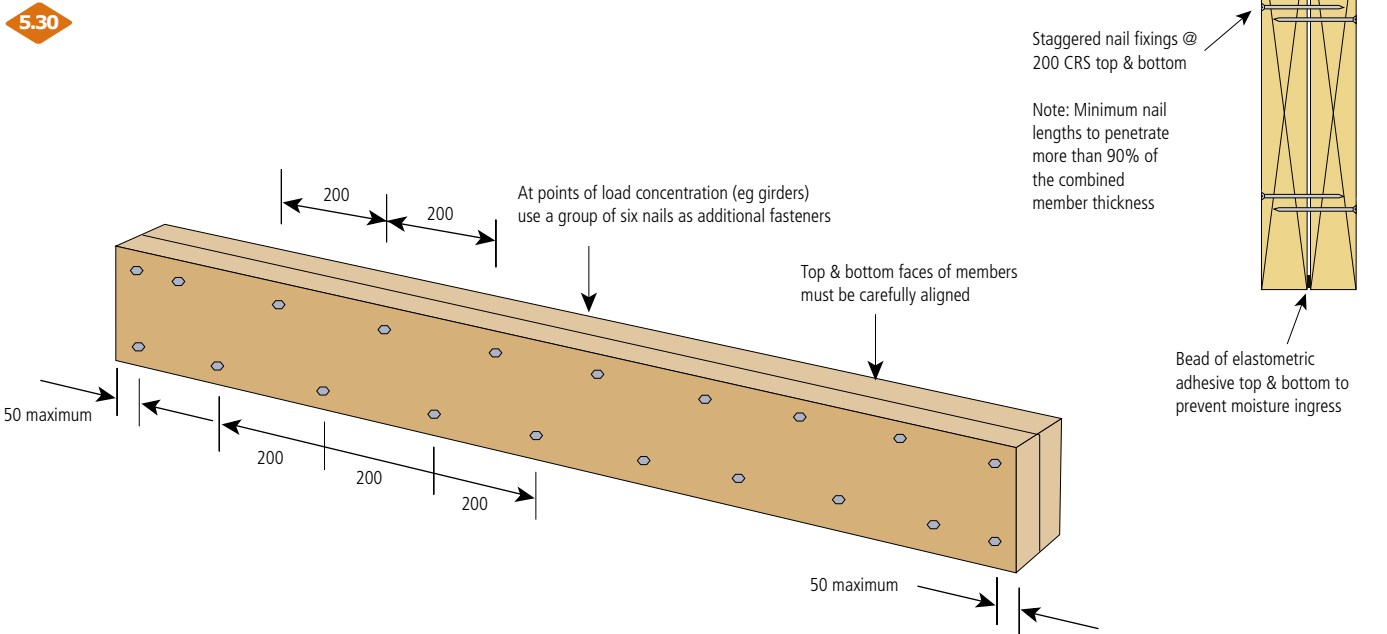

PLEASE NOTE:

- Where the double member supports another member fixed to its face, additional nailing is required from the reverse side of the beam.
- Additional fasteners will also be required at points of concentrated load.
- Skew nailing is required to avoid prying.
- All nails to be alternatively skewed (30° to vertical)
- An additional centre row of nails is required to both sides for beams 300mm in depth.
- Where a double component has a concentrated load from one side only, use 6x3.15mm diameter nails in the vicinity of the load. Fixing needs to be specifically designed when the load from one side is greater than 4.8kN.

| NAILING SCHEDULE | 2 X 44MM HYNE LGL | 75 x 3.15mm |
|------------------|-------------------|--------------|
| | 2 X 35 LVL | 70 x 3.15mm |
| | 2 X 45 LVL | 90 x 3.15mm |
| | 2 X 63 LVL | 120 x 3.15mm |



Refers to superseded detail number

To use:

1. Select the required depth of I-Beam.
2. Determine the support condition for the nearest bearing: End support or interior support (including cantilever-end supports).
3. Select the row corresponding to the required span. For spans between those listed, use the next largest value.
4. Select the column corresponding to the required hole diameter. For diameters between those listed, use the next largest value.
5. The intersection of the Span row and Hole Diameter column gives the minimum distance from the inside face of bearing to the centre of a circular hole.
6. Double check the distance to the other support, using the appropriate support condition.

Notes:

1. **Cut holes carefully! Do not overcut holes! Do not cut or notch joist top and bottom flanges.**
2. Holes may be placed anywhere within the depth of the joist. A minimum 2mm clear distance is required between the hole and the flanges.
3. Round holes up to 38mm diameter may be placed anywhere in the web
4. Perforated "knockouts" may be neglected when locating web holes.
5. Holes larger than 38mm are not permitted in cantilevers without special engineering.
6. Multiple holes shall have a clear separation along the length of the joist of at least twice the length of the larger adjacent hole, or a minimum of 305mm centre-to-centre, whichever is greater.
7. Multiple holes may be spaced closer than specified, but the assessment of the hole must be made for a hole diameter that would enclose both smaller holes together.
8. Locating holes in joists with spans exceeding those in the tables or larger holes, greater uniform loads or non-uniform loads, and closer proximity to supports and other holes may be possible with analysis using Hyne Design (HD) 7 software. Please contact New Zealand Wood Products (NZWOOD) Limited for more information.

| JOIST DEPTH (MM) | CLEAR SPAN (M) | DISTANCE (x) FROM END SUPPORT (M) | | | | | | DISTANCE (x) FROM INTERIOR OR CANT END SUPPORT (M) | | | | | |
|------------------|----------------|-----------------------------------|-------|-------|-------|-------|-------|--|-------|-------|-------|-------|-------|
| | | HOLE DIAMETER (MM) | | | | | | HOLE DIAMETER (MM) | | | | | |
| | | 50MM | 100MM | 150MM | 165MM | 225MM | 280MM | 50MM | 100MM | 150MM | 165MM | 225MM | 280MM |
| LPI™ 70-T 225 | 2.0M | 0.30 | 0.30 | 0.30 | - | - | - | 0.30 | 0.30 | 0.36 | - | - | - |
| | 3.0M | 0.30 | 0.30 | 0.66 | - | - | - | 0.30 | 0.36 | 1.09 | - | - | - |
| | 4.0M | 0.30 | 0.51 | 1.27 | - | - | - | 0.38 | 1.07 | 1.88 | - | - | - |
| | 5.0M | 0.38 | 1.09 | 1.93 | - | - | - | 1.04 | 1.80 | - | - | - | - |
| | 6.0M | 0.94 | 1.70 | 2.62 | - | - | - | 1.78 | 2.59 | - | - | - | - |
| LPI™ 70-T 240 | 2.0M | 0.30 | 0.30 | 0.30 | 0.30 | - | - | 0.30 | 0.30 | 0.30 | 0.33 | - | - |
| | 3.0M | 0.30 | 0.30 | 0.43 | 0.64 | - | - | 0.30 | 0.30 | 0.84 | 1.07 | - | - |
| | 4.0M | 0.30 | 0.30 | 1.02 | 1.27 | - | - | 0.30 | 0.84 | 1.60 | 1.85 | - | - |
| | 5.0M | 0.30 | 0.84 | 1.65 | 1.93 | - | - | 0.84 | 1.55 | 2.39 | - | - | - |
| | 6.0M | 0.71 | 1.45 | 2.31 | 2.59 | - | - | 1.52 | 2.31 | - | - | - | - |
| LPI™ 70-T 300 | 2.0M | 0.30 | 0.30 | 0.30 | 0.30 | 0.30 | - | 0.30 | 0.30 | 0.30 | 0.30 | 0.41 | - |
| | 3.0M | 0.30 | 0.30 | 0.30 | 0.30 | 0.71 | - | 0.30 | 0.30 | 0.30 | 0.30 | 1.14 | - |
| | 4.0M | 0.30 | 0.30 | 0.30 | 0.46 | 1.32 | - | 0.30 | 0.30 | 0.81 | 1.02 | 1.93 | - |
| | 5.0M | 0.30 | 0.30 | 0.84 | 1.04 | 2.01 | - | 0.30 | 0.84 | 1.52 | 1.75 | - | - |
| | 6.0M | 0.30 | 0.74 | 1.42 | 1.65 | 2.67 | - | 0.89 | 1.55 | 2.29 | 2.51 | - | - |
| LPI™ 70-T 356 | 2.0M | 0.30 | 0.30 | 0.30 | 0.30 | 0.30 | 0.30 | 0.30 | 0.30 | 0.30 | 0.30 | 0.30 | 0.46 |
| | 3.0M | 0.30 | 0.30 | 0.30 | 0.30 | 0.30 | 0.76 | 0.30 | 0.30 | 0.30 | 0.30 | 0.46 | 1.19 |
| | 4.0M | 0.30 | 0.30 | 0.30 | 0.30 | 0.61 | 1.40 | 0.30 | 0.30 | 0.30 | 0.41 | 1.17 | 2.01 |
| | 5.0M | 0.30 | 0.30 | 0.30 | 0.41 | 1.19 | 2.08 | 0.30 | 0.30 | 0.91 | 1.09 | 1.93 | - |
| | 6.0M | 0.30 | 0.30 | 0.79 | 0.97 | 1.83 | 2.77 | 0.38 | 0.97 | 1.60 | 1.80 | 2.72 | - |
| 7.0M | 0.30 | 0.71 | 1.35 | 1.57 | 2.46 | 3.45 | 1.04 | 1.68 | 2.34 | 2.57 | - | - | |
| 8.0M | 0.66 | 1.27 | 1.96 | 2.18 | 3.12 | - | 1.73 | 2.39 | 3.12 | 3.35 | - | - | |

Design assumptions:


1. The hole locations listed above are valid for floor joists supporting only uniform loads that do not exceed those set out in the standard flooring span tables.
2. Hole location is measured from the inside face of bearing to the centre of a circular hole, from the closest support.
3. Clear Span has not been verified for these joists and is shown for informational purposes only. Verify that the joist selected will work for the span and loading conditions needed before checking hole location.
4. The maximum circular hole diameters for I-Beams are: 150mm Dia for 225mm deep, 165mm Dia for 240mm deep, 225mm Dia for 300mm deep and 280mm Dia for 356mm deep.
5. Holes cannot be located in the span where designated "-", without further analysis by a design professional.

Holes in LP I-Beams


5.1

A Round Holes

6.0

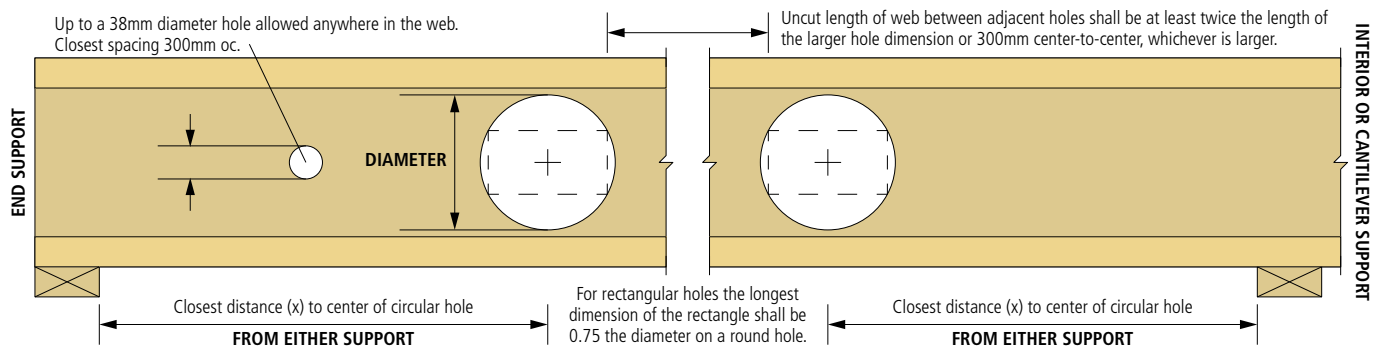

B Square Holes

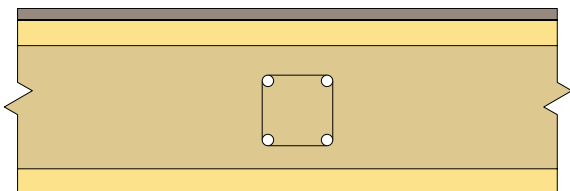

Note: For rectangular hole sizes the longest dimension of the rectangular shall be 0.75 the diameter of a round hole


PLEASE NOTE:

- Never drill, cut or notch the flange, or over-cut the web.
- The holes in the web should be cut with a sharp saw.
- For rectangular holes, avoid over cutting the corners as this can cause stress concentrations.
- Slightly rounding the corners is recommended to avoid over-cutting, for rectangular holes.
- Start the rectangular hole by drilling a 10mm diameter hole in each of the four corners and then making the cuts between the holes to minimise damage to the web.




Service Holes Hyne Beam & Hyne LGL

5.2 Vertical Hole Locations in 17c Beams Only

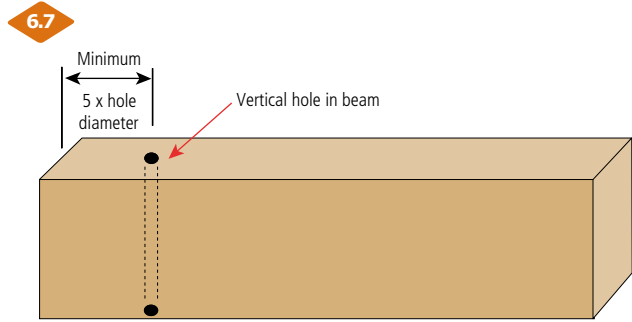

5.3 Service Hole Locations in Hyne LGL & 17c Beams

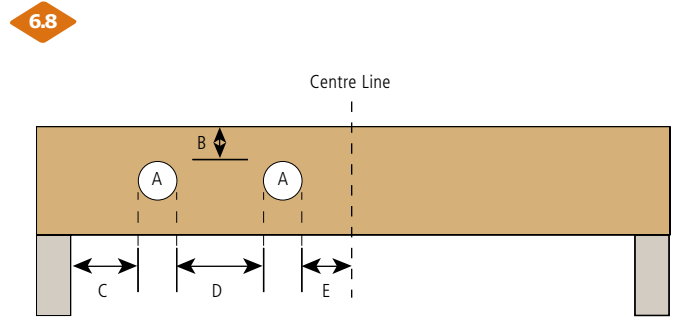


5.4 Service Holes in Hyne LGL & 17c Beams

6.10 The following table outlines the requirements for holes being drilled through Hyne LGL and 17C floor members. For 18C and 21C please phone the technical helpline on 0800 022 357.


| | A | B | C | D | E | F |
|----------------------|----------------------------|-----------------------------------|---|----------------------|--------------------------------------|---------------------------------|
| HYNE LGL & 17C BEAMS | MAXIMUM HOLE DIAMETER (MM) | TOP AND BOTTOM EDGE DISTANCE (MM) | MINIMUM END DISTANCE FROM SUPPORT FACE (MM) | MINIMUM HOLE SPACING | MINIMUM DISTANCE FROM CENTRE OF SPAN | MAXIMUM NUMBER OF HOLES IN SPAN |
| 200 | 25 | 30 | 70 | 5 x Diameter | None | 3 Holes / Halfspan |
| | 40 | 55 | 290 | 5 x Diameter | None | 3 Holes / Halfspan |
| | 55 | 55 | 880 | 5 x Diameter | 440 | 2 Holes / Halfspan |
| | 75 | 55 | 880 | 1300mm | 650 | 1 Hole / Halfspan |
| 240 | 25 | 30 | 70 | 5 x Diameter | None | 3 Holes / Halfspan |
| | 50 | 70 | 360 | 5 x Diameter | None | 3 Holes / Halfspan |
| | 70 | 70 | 1050 | 5 x Diameter | 520 | 2 Holes / Halfspan |
| | 95 | 70 | 1050 | 1600mm | 800 | 1 Hole / Halfspan |
| 295 OR LARGER | 25 | 30 | 70 | 5 x Diameter | None | 3 Holes / Halfspan |
| | 60 | 85 | 440 | 5 x Diameter | None | 3 Holes / Halfspan |
| | 85 | 85 | 1200 | 5 x Diameter | 600 | 2 Holes / Halfspan |
| | 115 | 85 | 1200 | 1800mm | 900 | 1 Hole / Halfspan |

Service Holes Hyne Beam & Hyne LGL

5.5 Fastening Horizontal Holes for Shear Loads

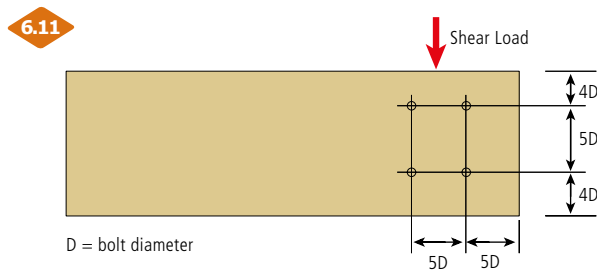

5.6 Fastening Horizontal Holes for Tension Loads

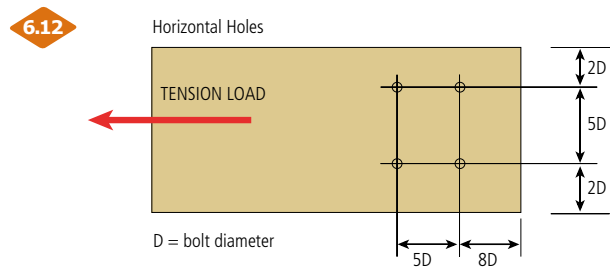

PLEASE NOTE:
Details show minimum bolt spacing & bolt edge distances


| BEAM WIDTH (MM) | MAX HOLE DIA (MM) | MIN HOLE SPACING (MM) |
|-----------------|-------------------|-----------------------|
| 65 | 15 | 390 |
| 85/130 | 22 | 510 |

Refers to superseded detail number

Overcoming Splitting / Taper Cuts - LGL, 17C & LVL

6.1 Details


7.0

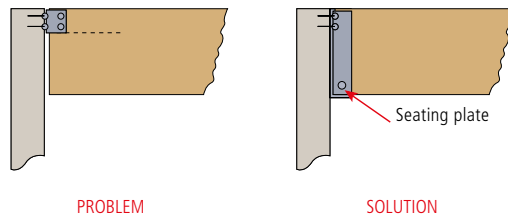

Splitting at bolted beam support.

6.2 Details


7.1

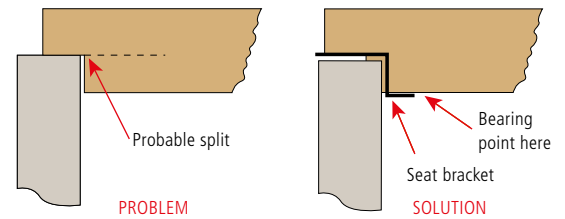

Splitting at notched beam support.

6.3 Details


7.2

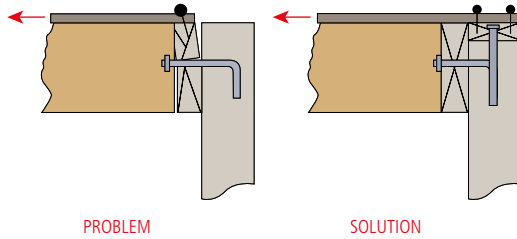

Splitting due to lateral loads in diaphragm connection.

6.4 Details

7.3

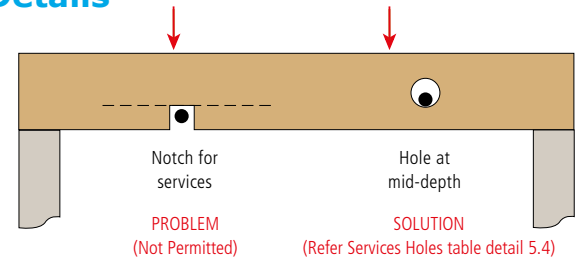


Splitting at notch in beam.

6.5 Unreinforced Tapercut

7.4

Taper cut length must not exceed 0.15 of the beam span

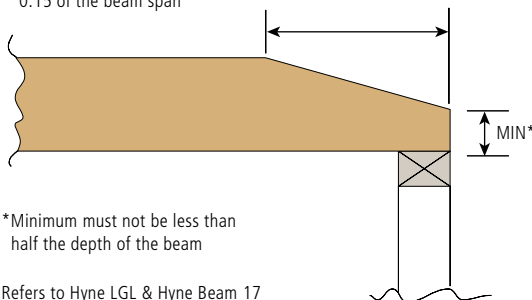


*Minimum must not be less than half the depth of the beam

Refers to Hyne LGL & Hyne Beam 17

6.6 Nail Plate Reinforced Taper Cut

7.5

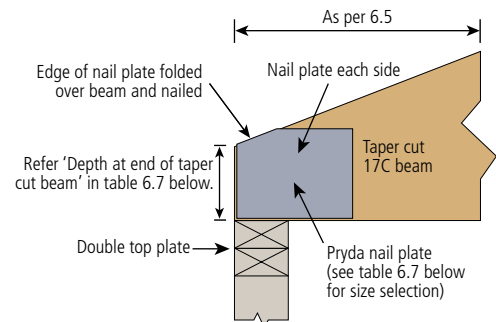

Pryda NPA 150/190 Nail Plate - 72/30 x 3.15mm nails
Pryda NPB 150/250 Nail Plate - 94/30 x 3.15mm nails
Taper cut length must not exceed 15% of the beam span

6.7 Nail Plate Sizes For Reinforced Taper Cuts Applies to 85mm Hyne Beam 17

7.6

Please phone the technical helpline on 0800 022 357 for beams not listed below.

| HYNE 17C BEAM SIZE | NAIL PLATES | | TAPER CUT DETAILS | |
|--------------------|-------------------------------------|-------------|-------------------|-------------|
| | DEPTH AT END OF TAPER CUT BEAM (MM) | | | |
| | 130 | 160 | 190 | 220 |
| 330 X 85 | NPA 150/190 | X | X | X |
| 360 X 85 | NPA 150/190 | X | X | X |
| 395 X 85 | NPB 150/250 | NPB 150/250 | X | X |
| 425 X 85 | NPB 150/250 | NPB 150/250 | NPB 150/250 | X |
| 460 X 85 | NPB 150/250 | NPB 150/250 | NPB 150/250 | X |
| 525 X 85 | NPB 150/250 | NPB 150/250 | NPB 150/250 | NPB 150/250 |

PLEASE NOTE:

Plate to be placed symmetrically about the inner face of the support, i.e. on the shear line

Maximum reaction load for 150 deep NPA is 35kN ultimate. Maximum reaction load for 150 deep NPB is 70kN ultimate

X - indicates where the beam would have more than 50% depth

INSTALLATION: Use 30 x 3.15mm Pryda Timber Connector, Galvanised Nails - GBC030315 (500G)




Refers to superseded detail number

Standard Lintels


Lintel Supporting Girder Truss

Note: All lintel to stud fixings to be in accordance with NZS3604:2011

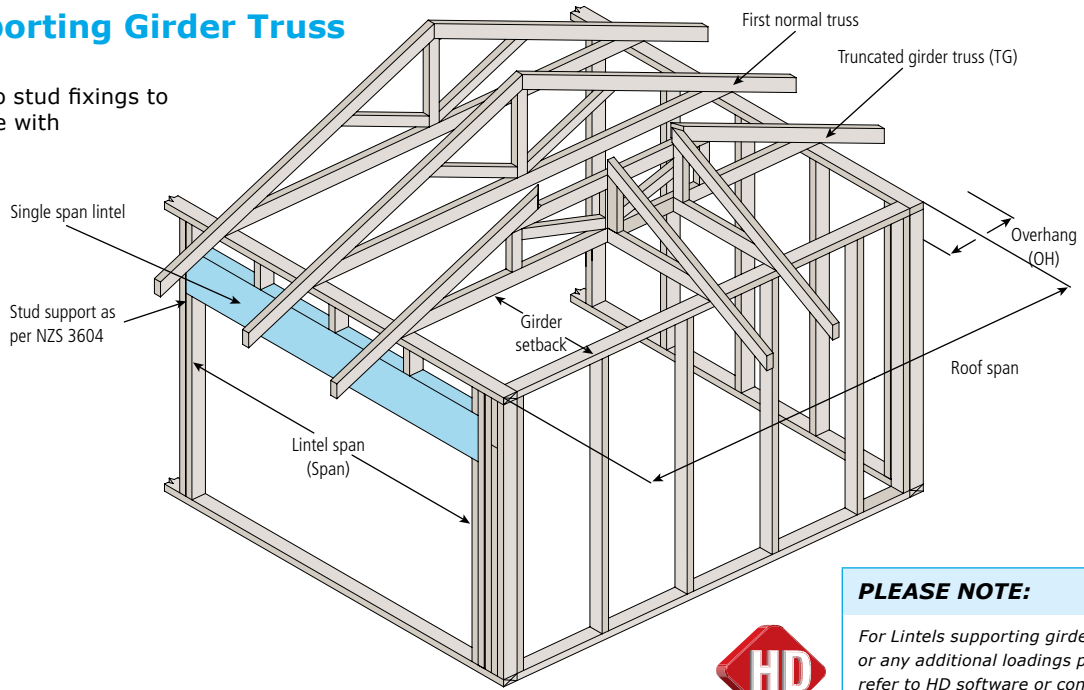


PLEASE NOTE:
For Lintels supporting girder trusses or any additional loadings please refer to HD software or contact your technical rep.


Defining Roof Load Width

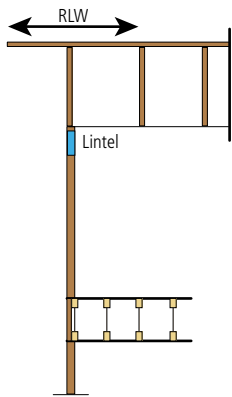

Roof load width for gable end

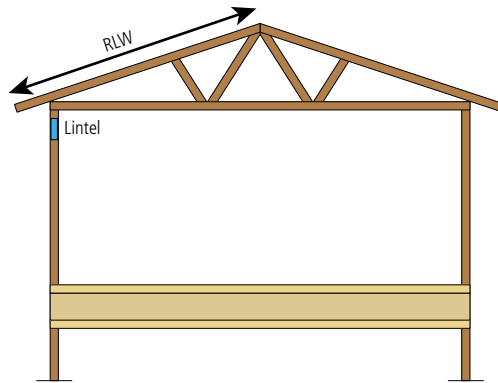

Roof load width for truss design

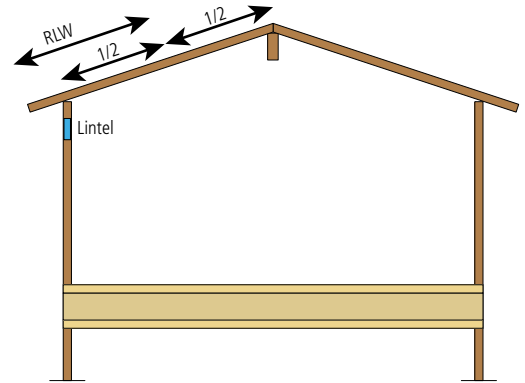

Roof load width for rafter design

Standard Lintel - I-Built 90 LVL

Span Table - Supporting roof loads only - Up to high wind zone / 30° slope

| ROOFING TYPE | LINTEL SIZE | MAXIMUM LINTEL SPAN (M) | | | | | | | | | |
|---|-------------|---------------------------|-----|-----|-----|------------|------------|------------|-------------|-------------|-------------|
| | | ROOF LOAD WIDTH - RLW (M) | | | | | | | | | |
| | | 1.5 | 2 | 2.5 | 3 | 3.5 | 4 | 4.5 | 5 | 5.5 | 6 |
| METAL ROOF AND CEILING (40KG/M ²) | 150 x 90 | 3.2 | 3.0 | 2.8 | 2.6 | 2.5 | 2.4 | 2.3 | 2.3 | 2.2 | 2.1 |
| | 200 x 90 | 3.9 | 3.7 | 3.5 | 3.4 | 3.3 | 3.2 | 3.1 | 3.0 | 2.9 | 2.9 |
| | 240 x 90 | 4.5 | 4.3 | 4.1 | 3.9 | 3.8 | 3.6 | 3.5 | 3.5 | 3.4 | 3.3 |
| | 300 x 90 | 5.3 | 5.0 | 4.8 | 4.6 | 4.5 | 4.3 | 4.2 | 4.1 | 4.0 | 3.9 |
| | 360 x 90 | 6.1 | 5.8 | 5.5 | 5.3 | 5.1 | 5.0 | 4.8 | 4.7 | 4.6 | 4.5 |
| 400 x 90 | 6.6 | 6.3 | 6.0 | 5.7 | 5.5 | 5.4 | 5.2 | 5.1 | 5.0# | 4.9# | |
| TILED ROOF AND CEILING (90KG/M ²) | 150 x 90 | 2.6 | 2.3 | 2.2 | 2.1 | 2.0 | 1.9 | 1.8 | 1.7 | 1.7 | 1.6 |
| | 200 x 90 | 3.3 | 3.1 | 2.9 | 2.8 | 2.6 | 2.5 | 2.4 | 2.3 | 2.3 | 2.2 |
| | 240 x 90 | 3.8 | 3.5 | 3.4 | 3.2 | 3.1 | 3.0 | 2.9 | 2.8 | 2.7 | 2.6 |
| | 300 x 90 | 4.5 | 4.2 | 4.0 | 3.8 | 3.7 | 3.6 | 3.5 | 3.4 | 3.3# | 3.2# |
| | 360 x 90 | 5.2 | 4.8 | 4.6 | 4.4 | 4.2 | 4.1 | 4.0# | 3.9# | 3.8# | 3.7# |
| | 400 x 90 | 5.6 | 5.2 | 5.0 | 4.8 | 4.6 | 4.4# | 4.3# | 4.2# | 4.1# | 4.0# |

Denotes member must have minimum 2x45mm stud supports at each end

4.0 - Uplift fixings to NZS3604, Figure 8.12

4.0 - Uplift fixings requiring Specific Eng Design

PLEASE NOTE:

These span tables provide maximum member spans to 100% of the recommended capacity. It is recommended that deflection is limited to 5mm to ensure the continued performance of items such as Bifolding door joinery is maintained



Standard Lintel - I-Built 90 LVL

Span Table - Supporting roof, ceiling & floor load only - Up to high wind zone

| ROOFING TYPE | LINTEL SIZE | FLOOR LOAD WIDTH (FLW) | MAXIMUM LINTEL SPAN (M) | | | | |
|--|-------------|------------------------|---------------------------|------|------|------|------|
| | | | ROOF LOAD WIDTH - RLF (M) | | | | |
| | | | 2 | 3 | 4 | 5 | 6 |
| METAL ROOF AND CEILING (40KG/M ²) | 150 x 90 | 1 | 2.1 | 2.0 | 1.9 | 1.9 | 1.8 |
| | | 2 | 1.9 | 1.9 | 1.8 | 1.7 | 1.7 |
| | | 3 | 1.8 | 1.7 | 1.7 | 1.6 | 1.6 |
| | 200 x 90 | 1 | 2.8 | 2.7 | 2.6 | 2.5 | 2.4 |
| | | 2 | 2.6 | 2.5 | 2.4 | 2.3 | 2.3 |
| | | 3 | 2.4 | 2.3 | 2.3 | 2.2 | 2.1 |
| | 240 x 90 | 1 | 3.3 | 3.2 | 3.1 | 3.0 | 2.9 |
| | | 2 | 3.1 | 3.0 | 2.9 | 2.8 | 2.7 |
| | | 3 | 2.9 | 2.8 | 2.7# | 2.7# | 2.6# |
| | 300 x 90 | 1 | 3.9 | 3.8 | 3.7 | 3.6 | 3.5 |
| | | 2 | 3.6 | 3.5 | 3.4# | 3.4# | 3.3# |
| | | 3 | 3.4# | 3.4# | 3.3# | 3.2# | 3.2# |
| | 360 x 90 | 1 | 4.5 | 4.3 | 4.2 | 4.1# | 4.0# |
| | | 2 | 4.2# | 4.1# | 4.0# | 3.9# | 3.8# |
| | | 3 | 3.9# | 3.9# | 3.8# | 3.7# | 3.6# |
| | 400 x 90 | 1 | 4.9 | 4.7 | 4.5 | 4.4# | 4.3# |
| | | 2 | 4.5# | 4.4# | 4.3# | 4.2# | 4.1# |
| | | 3 | 4.3# | 4.2# | 4.1# | 4.0# | 3.9# |
| TILED ROOF AND CEILING (90KG/M ²) | 150 x 90 | 1 | 1.9 | 1.8 | 1.7 | 1.6 | 1.5 |
| | | 2 | 1.8 | 1.7 | 1.6 | 1.5 | 1.4 |
| | | 3 | 1.7 | 1.6 | 1.5 | 1.4 | 1.4 |
| | 200 x 90 | 1 | 2.5 | 2.4 | 2.2 | 2.1 | 2.0 |
| | | 2 | 2.4 | 2.2 | 2.1 | 2.0 | 1.9 |
| | | 3 | 2.2 | 2.1 | 2.0 | 1.9 | 1.9# |
| | 240 x 90 | 1 | 3.0 | 2.8 | 2.7 | 2.5 | 2.4 |
| | | 2 | 2.8 | 2.7 | 2.5 | 2.4# | 2.3# |
| | | 3 | 2.7 | 2.5# | 2.4# | 2.3# | 2.3# |
| | 300 x 90 | 1 | 3.6 | 3.4 | 3.2 | 3.1# | 3.0# |
| | | 2 | 3.4 | 3.3# | 3.1# | 3.0# | 2.9# |
| | | 3 | 3.3# | 3.1# | 3.0# | 2.9# | 2.8# |
| | 360 x 90 | 1 | 4.1 | 3.9 | 3.7# | 3.6# | 3.5# |
| | | 2 | 3.9# | 3.7# | 3.6# | 3.5# | 3.4# |
| | | 3 | 3.7# | 3.6# | 3.5# | 3.4# | 3.3# |
| | 400 x 90 | 1 | 4.5 | 4.2# | 4.0# | 3.9# | 3.8# |
| | | 2 | 4.2# | 4.0# | 3.9# | 3.8# | 3.7# |
| | | 3 | 4.1# | 3.9# | 3.8# | 3.7# | 3.6# |

Denotes member must have minimum 2x45mm stud supports at each end
4.0 - Uplift fixings to NZS3604, Figure 8.12

Standard Lintel - I-Built LVL 13

Span Table - Supporting roof and ceiling load only - Up to high wind zone

| ROOFING TYPE | LINTEL SIZE | MAXIMUM LINTEL SPAN (M) | | | | | | | | | |
|---|-------------|-------------------------|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| | | ROOF LOAD WIDTH (M) | | | | | | | | | |
| | | 1.5 | 2 | 2.5 | 3 | 3.5 | 4 | 4.5 | 5 | 5.5 | 6 |
| LIGHT ROOF: METAL ROOF AND CEILING (40KG/M ²) | 2/150 X 45 | 3.5 | 3.3 | 3.1 | 2.9 | 2.8 | 2.6 | 2.5 | 2.4 | 2.3 | 2.2 |
| | 2/200 X 45 | 4.3 | 4.0 | 3.8 | 3.6 | 3.5 | 3.4 | 3.3 | 3.2 | 3.1 | 3.0 |
| | 2/240 X 45 | 5.0 | 4.6 | 4.4 | 4.2 | 4.0 | 3.9 | 3.7 | 3.6 | 3.5 | 3.4 |
| | 2/300 X 45 | 5.8 | 5.4 | 5.2 | 4.9 | 4.7 | 4.6 | 4.4 | 4.3 | 4.2 | 4.1 |
| | 2/360 X 45 | 6.6 | 6.2 | 5.9 | 5.6 | 5.4 | 5.2 | 5.0 | 4.9 | 4.8 | 4.6 |
| | 150 X 63 | 3.5 | 3.2 | 3.0 | 2.9 | 2.7 | 2.6 | 2.5 | 2.4 | 2.3 | 2.2 |
| | 200 X 63 | 4.3 | 4.0 | 3.8 | 3.6 | 3.4 | 3.3 | 3.2 | 3.1 | 3.0 | 2.9 |
| | 240 X 63 | 4.9 | 4.6 | 4.3 | 4.1 | 4.0 | 3.8 | 3.7 | 3.6 | 3.5 | 3.4 |
| | 300 X 63 | 5.8 | 5.4 | 5.1 | 4.9 | 4.7 | 4.5 | 4.3 | 4.2 | 4.1 | 4.0 |
| 360 X 63 | 6.6 | 6.2 | 5.8 | 5.6 | 5.3 | 5.2 | 5.0 | 4.8 | 4.7 | 4.6 | |
| HEAVY ROOF: TILED ROOF AND CEILING (90KG/M ²) | 2/150 X 45 | 2.9 | 2.7 | 2.5 | 2.3 | 2.2 | 2.1 | 2.0 | 1.9 | 1.8 | 1.8 |
| | 2/200 X 45 | 3.6 | 3.4 | 3.2 | 3.0 | 2.9 | 2.8 | 2.7 | 2.6 | 2.5 | 2.4 |
| | 2/240 X 45 | 4.2 | 3.9 | 3.7 | 3.5 | 3.4 | 3.2 | 3.1 | 3.1 | 3.0 | 2.9 |
| | 2/300 X 45 | 4.9 | 4.6 | 4.3 | 4.1 | 4.0 | 3.8 | 3.7 | 3.6 | 3.5 | 3.4 |
| | 2/360 X 45 | 5.6 | 5.2 | 5.0 | 4.7 | 4.6 | 4.4 | 4.3 | 4.1 | 4.0 | 3.9 |
| | 150 X 63 | 2.9 | 2.6 | 2.4 | 2.3 | 2.1 | 2.0 | 1.9 | 1.9 | 1.8 | 1.7 |
| | 200 X 63 | 3.6 | 3.3 | 3.1 | 3.0 | 2.9 | 2.7 | 2.6 | 2.5 | 2.4 | 2.3 |
| | 240 X 63 | 4.1 | 3.8 | 3.6 | 3.4 | 3.3 | 3.2 | 3.1 | 3.0 | 2.9 | 2.8 |
| | 300 X 63 | 4.9 | 4.5 | 4.3 | 4.1 | 3.9 | 3.8 | 3.7 | 3.6 | 3.5 | 3.4 |
| 360 X 63 | 5.6 | 5.2 | 4.6 | 4.7 | 4.5 | 4.3 | 4.2 | 4.1 | 4.0 | 3.9 | |

PLEASE NOTE:

These span tables provide maximum member spans to 100% of the recommended capacity. It is recommended that deflection is limited to 5mm to ensure the continued performance of items such as Bifolding door joinery is maintained



Standard Lintel - Hyne LGL 44mm

Span Table - Supporting roof and ceiling load only - Up to high wind zone

| ROOFING TYPE | LINTEL SIZE | MAXIMUM LINTEL SPAN (M) | | | | | | | | | |
|---|-------------|-------------------------|-----|-----|-----|-----|-----|-----|------|------|------|
| | | ROOF LOAD WIDTH (M) | | | | | | | | | |
| | | 1.5 | 2 | 2.5 | 3 | 3.5 | 4 | 4.5 | 5 | 5.5 | 6 |
| METAL ROOF AND CEILING (40KG/M ²) | 2/200 X 44 | 4.5 | 4.2 | 4.0 | 3.8 | 3.6 | 3.5 | 3.4 | 3.3 | 3.2 | 3.1 |
| | 2/245 X 44 | 5.2 | 4.9 | 4.6 | 4.4 | 4.2 | 4.1 | 3.9 | 3.8 | 3.7 | 3.6 |
| | 2/300 X 44 | 6.1 | 5.7 | 5.4 | 5.1 | 4.9 | 4.7 | 4.6 | 4.4 | 4.3 | 4.2 |
| | 2/360 X 44 | 6.9 | 6.5 | 6.1 | 5.8 | 5.6 | 5.4 | 5.2 | 5.1 | 4.9 | 4.8 |
| TILED ROOF AND CEILING (90KG/M ²) | 2/200 X 44 | 3.7 | 3.4 | 3.2 | 3.1 | 3.0 | 2.8 | 2.8 | 2.6 | 2.5 | 2.4 |
| | 2/245 X 44 | 4.3 | 4.0 | 3.8 | 3.6 | 3.5 | 3.5 | 3.3 | 3.1 | 3.1 | 3.0 |
| | 2/300 X 44 | 5.0 | 4.7 | 4.4 | 4.2 | 4.0 | 4.0 | 3.9 | 3.7 | 3.6 | 3.5* |
| | 2/360 X 44 | 5.7 | 5.3 | 5.0 | 4.8 | 4.6 | 4.6 | 4.5 | 4.2* | 4.1* | 4.0* |

* Denotes member must have a minimum 45mm bearing at the 2 supports

Standard Lintel - I-Built LVL 11

Span Table - Supporting roof and ceiling load only - Up to high wind zone

| ROOFING TYPE | LINTEL SIZE | MAXIMUM LINTEL SPAN (M) | | | | | | | | | |
|---|-------------|-------------------------|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| | | ROOF LOAD WIDTH (M) | | | | | | | | | |
| | | 1.5 | 2 | 2.5 | 3 | 3.5 | 4 | 4.5 | 5 | 5.5 | 6 |
| LIGHT ROOF: METAL ROOF AND CEILING (40KG/M ²) | 2/140 X 45 | 3.2 | 3.0 | 2.7 | 2.6 | 2.4 | 2.3 | 2.2 | 2.1 | 2.0 | 2.0 |
| | 2/190 X 45 | 4.0 | 3.7 | 3.5 | 3.3 | 3.2 | 3.1 | 3.0 | 2.9 | 2.8 | 2.7 |
| | 2/240 X 45 | 4.7 | 4.4 | 4.2 | 4.0 | 3.8 | 3.7 | 3.6 | 3.5 | 3.4 | 3.3 |
| | 2/300 X 45 | 5.6 | 5.2 | 4.9 | 4.7 | 4.5 | 4.3 | 4.2 | 4.1 | 4.0 | 3.9 |
| HEAVY ROOF: TILED ROOF AND CEILING (90KG/M ²) | 2/140 X 45 | 2.6 | 2.3 | 2.2 | 2.0 | 1.9 | 1.8 | 1.7 | 1.7 | 1.6 | 1.6 |
| | 2/190 X 45 | 3.3 | 3.1 | 2.9 | 2.8 | 2.6 | 2.5 | 2.4 | 2.3 | 2.2 | 2.1 |
| | 2/240 X 45 | 4.0 | 3.7 | 3.5 | 3.3 | 3.2 | 3.1 | 3.0 | 2.9 | 2.8 | 2.7 |
| | 2/300 X 45 | 4.7 | 4.4 | 4.1 | 3.9 | 3.8 | 3.7 | 3.5 | 3.4 | 3.4 | 3.3 |

* Denotes member must have a minimum 45mm bearing at the 2 supports

Standard Lintel - Hyne Beam 17C

Span Table - Supporting roof and ceiling load only - Up to high wind zone

| ROOFING TYPE | LINTEL SIZE | MAXIMUM LINTEL SPAN (M) | | | | | | | | | |
|---|-------------|-------------------------|------|------|------|------|------|------|------|------|------|
| | | ROOF LOAD WIDTH (M) | | | | | | | | | |
| | | 1.5 | 2 | 2.5 | 3 | 3.5 | 4 | 4.5 | 5 | 5.5 | 6 |
| METAL ROOF AND CEILING (40KG/M ²) | 195 X 85 | 5.7 | 5.2 | 4.9 | 4.6 | 4.4 | 4.2 | 4.0 | 3.9 | 3.8 | 3.7 |
| | 230 X 85 | 6.6 | 6.1 | 5.7 | 5.3 | 5.1 | 4.8 | 4.7 | 4.5 | 4.3 | 4.2 |
| | 260 X 85 | 7.5 | 6.8 | 6.3 | 6.0 | 5.7 | 5.4 | 5.2 | 5.0 | 4.8 | 4.7 |
| | 295 X 85 | 8.4 | 7.7 | 7.2 | 6.7 | 6.4 | 6.1 | 5.8 | 5.6 | 5.4 | 5.2 |
| | 330 X 85 | 9.5 | 8.6 | 8.0 | 7.5 | 7.1 | 6.8 | 6.5 | 6.2 | 6.0 | 5.8 |
| | 360 X 85 | 10.4 | 9.4 | 8.7 | 8.2 | 7.8 | 7.4 | 7.1 | 6.8 | 6.5 | 6.3 |
| | 395 X 85 | 11.4 | 10.4 | 9.6 | 9.0 | 8.5 | 8.1 | 7.7 | 7.4 | 7.2 | 6.9 |
| | 425 X 85 | 12.4 | 11.3 | 10.4 | 9.7 | 9.2 | 8.7 | 8.3 | 8.0 | 7.7 | 7.4 |
| | 495 X 85 | 14.7 | 13.3 | 12.3 | 11.5 | 10.8 | 10.3 | 9.8 | 9.4 | 9.0 | 8.7 |
| TILED ROOF AND CEILING (90KG/M ²) | 195 X 85 | 4.5 | 4.1 | 3.9 | 3.7 | 3.5 | 3.4 | 3.2 | 3.1 | 3.1 | 3.0 |
| | 230 X 85 | 5.2 | 4.8 | 4.5 | 4.2 | 4.0 | 3.9 | 3.7 | 3.6 | 3.5 | 3.4 |
| | 260 X 85 | 5.8 | 5.3 | 5.0 | 4.7 | 4.5 | 4.3 | 4.1 | 4.0 | 3.9 | 3.8 |
| | 295 X 85 | 6.5 | 6.0 | 5.6 | 5.3 | 5.0 | 4.8 | 4.6 | 4.5 | 4.3 | 4.2 |
| | 330 X 85 | 7.3 | 6.6 | 6.2 | 5.8 | 5.5 | 5.3 | 5.1 | 4.9 | 4.8 | 4.7 |
| | 360 X 85 | 7.9 | 7.2 | 6.7 | 6.3 | 6.0 | 5.8 | 5.5 | 5.3 | 5.2 | 5.0* |
| | 395 X 85 | 8.7 | 7.9 | 7.4 | 6.9 | 6.6 | 6.3 | 6.0 | 5.8* | 5.6* | 5.5* |
| | 425 X 85 | 9.4 | 8.5 | 7.9 | 7.4 | 7.1 | 6.7 | 6.5* | 6.3* | 6.0* | 5.9* |
| | 495 X 85 | 10.2 | 9.3 | 8.6 | 8.1 | 7.6 | 7.3* | 7.0* | 6.7* | 6.5* | 6.3# |
| | | 11.1 | 10.1 | 9.3 | 8.7 | 8.2 | 7.9* | 7.5* | 7.3# | 7.0# | 6.8# |

* Denotes Member must have a minimum 45mm bearing length at the 2 supports

Denotes Member must have a minimum 65mm bearing length at the 2 supports

PLEASE NOTE:


These span tables provide maximum member spans to 100% of the recommended capacity. It is recommended that deflection is limited to 5mm to ensure the continued performance of items such as Bifolding door joinery is maintained



Roof Construction Plan

7.1 Typical Roof Construction Plan

1.1 This is a typical roof construction plan. Please see detail numbers on the plan to locate specifics.

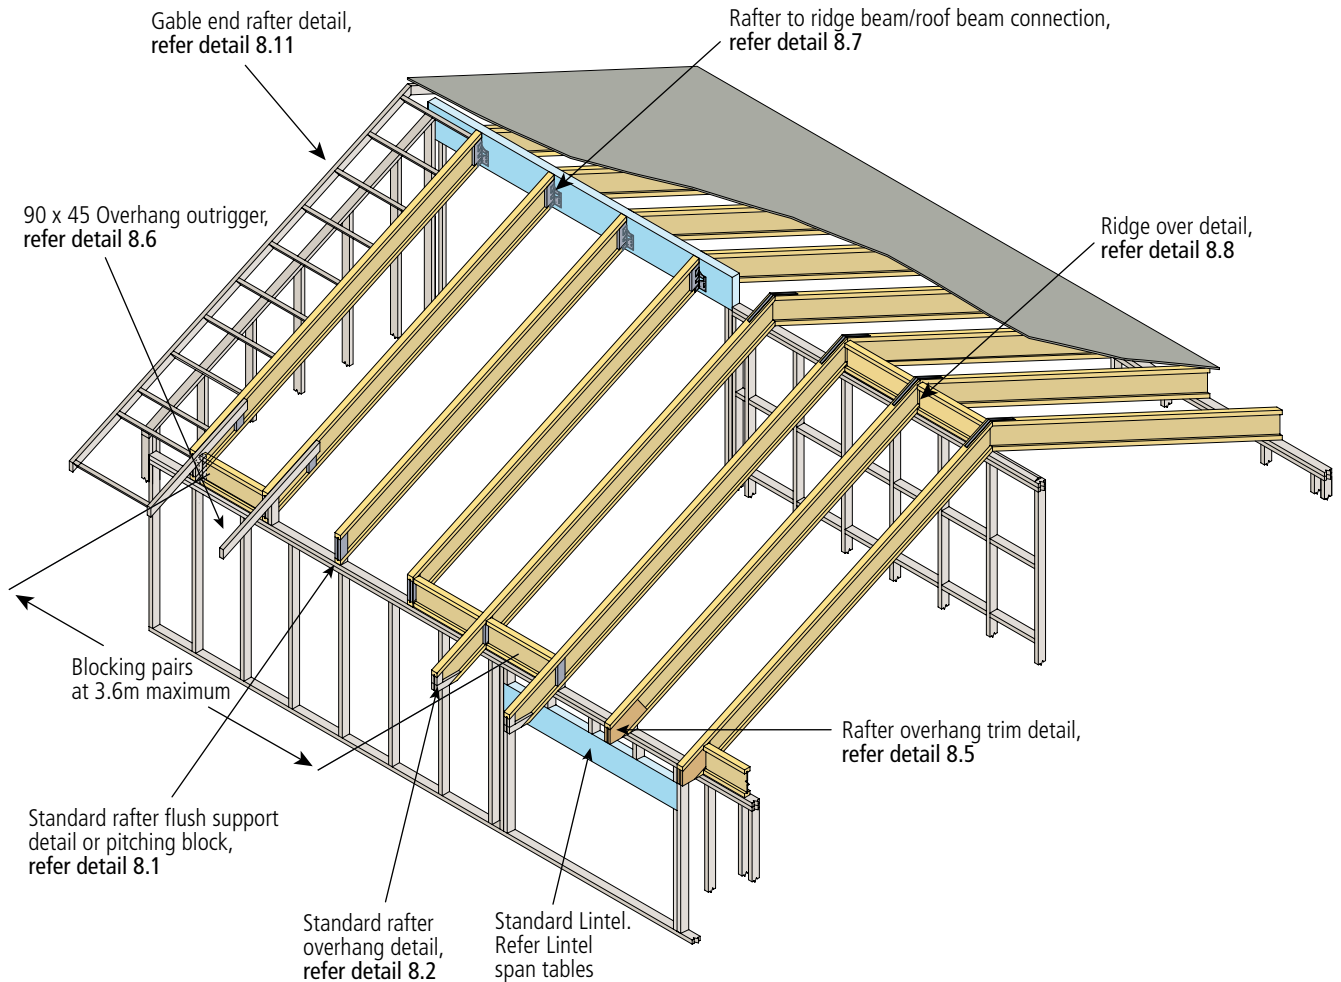

PLEASE NOTE:

- If a beam is above a window or a door, then it is a lintel. If not, then it is a bearer.
- Point Loads on rafters i.e. water storage cylinder, air-conditioning units and other such units, where higher permanent loads may be expected, specific engineering design should be applied – refer to HD software.
- The Span Tables in this brochure are designed as conservative spans. To run precise spans please use the HD software.

DESIGN CRITERIA:

- The tables provide realistic maximum spans for the given rafter spacings. The serviceability criteria used are as specified in AS/NZS 1170.

SNOW LOADS:

- Snow loads have not been considered in the preparation of these tables. Reference should be made to section 15 of NZS 3604:2011 – Timber framed buildings to determine the geographical area of the site. Specific engineering design should be applied – refer to HD software or contact your technical rep.



Rafter Span - LPI I-Beam

Single Span - Supporting Roof and Ceiling - Up to High Wind Zone

| | I-BEAM DEPTH | MAX RAFTER SPAN (M) | | | | | | | | | |
|----------------------------|---|---------------------|--------|--------|----------------|--------|--------|-----------------|--------|--------|-----|
| | | RAFTERS 600CRS | | | RAFTERS 900CRS | | | RAFTERS 1200CRS | | | |
| | | 0-15° | 15-25° | 25-35° | 0-15° | 15-25° | 25-35° | 0-15° | 15-25° | 25-35° | |
| WIND ZONE: HIGH (44M/ SEC) | METAL ROOF AND CEILING (40KG/M ²) | 225 x 70 | 6.3 | 6.0 | 5.6 | 5.7 | 5.5 | 5.1 | 5.2 | 5.0 | 4.7 |
| | | 240 x 70 | 6.6 | 6.2 | 5.8 | 6.0 | 5.7 | 5.3 | 5.5 | 5.3 | 4.9 |
| | | 300 x 53 | 7.0 | 6.6 | 6.2 | 6.3 | 6.1 | 5.6 | 5.9 | 5.6 | 5.2 |
| | | 300 x 70 | 7.4 | 7.1 | 6.6 | 6.8 | 6.5 | 6.0 | 6.3 | 6.0 | 5.6 |
| | | 356 x 70 | 8.1 | 7.8 | 7.2 | 7.4 | 7.1 | 6.6 | 6.9 | 6.6 | 6.1 |
| | TILED ROOF AND CEILING (90KG/M ²) | 225 x 70 | 5.0 | 4.8 | 4.5 | 4.4 | 4.2 | 3.9 | 4.0 | 3.8 | 3.6 |
| | | 240 x 70 | 5.3 | 5.1 | 4.8 | 4.6 | 4.4 | 4.2 | 4.2 | 4.0 | 3.8 |
| | | 300 x 53 | 5.8 | 5.5 | 5.1 | 5.0 | 4.8 | 4.5 | 4.6 | 4.4 | 4.1 |
| | | 300 x 70 | 6.2 | 5.9 | 5.4 | 5.5 | 5.3 | 4.9 | 5.0 | 4.8 | 4.5 |
| | | 356 x 70 | 6.8 | 6.4 | 6.0 | 6.1 | 5.8 | 5.4 | 5.7 | 5.4 | 5.0 |

Continuous Span - Supporting Roof and Ceiling - Up to High Wind Zone

| | I-BEAM DEPTH | MAX RAFTER SPAN (M) | | | | | | | | | |
|----------------------------|---|---------------------|--------|--------|----------------|--------|--------|-----------------|--------|--------|-----|
| | | RAFTERS 600CRS | | | RAFTERS 900CRS | | | RAFTERS 1200CRS | | | |
| | | 0-15° | 15-25° | 25-35° | 0-15° | 15-25° | 25-35° | 0-15° | 15-25° | 25-35° | |
| WIND ZONE: HIGH (44M/ SEC) | METAL ROOF AND CEILING (40KG/M ²) | 225 x 70 | 7.9 | 7.5 | 7.0 | 7.2 | 6.8 | 6.3 | 6.7 | 6.4 | 5.9 |
| | | 240 x 70 | 8.2 | 7.8 | 7.2 | 7.5 | 7.1 | 6.6 | 7.0 | 6.6 | 6.2 |
| | | 300 x 53 | 8.7 | 8.3 | 7.7 | 7.9 | 7.6 | 7.0 | 7.4 | 7.1 | 6.5 |
| | | 300 x 70 | 9.3 | 8.9 | 8.2 | 8.5 | 8.1 | 7.5 | 7.9 | 7.5 | 7.0 |
| | | 356 x 70 | 10.2 | 9.7 | 9.0 | 9.3 | 8.8 | 8.2 | 8.7 | 8.3 | 7.7 |
| | TILED ROOF AND CEILING (90KG/M ²) | 225 x 70 | 6.5 | 6.2 | 5.7 | 5.9 | 5.6 | 5.2 | 5.3 | 5.1 | 4.8 |
| | | 240 x 70 | 6.8 | 6.4 | 6.0 | 6.1 | 5.8 | 5.4 | 5.6 | 5.4 | 5.0 |
| | | 300 x 53 | 7.2 | 6.9 | 6.4 | 6.5 | 6.2 | 5.7 | 6.0 | 5.7 | 5.3 |
| | | 300 x 70 | 7.7 | 7.3 | 6.8 | 6.9 | 6.6 | 6.1 | 6.4 | 6.1 | 5.7 |
| | | 356 x 70 | 8.4 | 8.0 | 7.4 | 7.6 | 7.2 | 6.7 | 7.1 | 6.7 | 6.2 |

Rafter Span - Hyne LGL 44mm

Single Span - Supporting Roof and Ceiling - Up to High Wind Zone

| | LGL SIZE | MAX RAFTER SPAN (M) | | | | | | | | | |
|----------------------------|---|---------------------|--------|--------|----------------|--------|--------|-----------------|--------|--------|-----|
| | | RAFTERS 600CRS | | | RAFTERS 900CRS | | | RAFTERS 1200CRS | | | |
| | | 0-15° | 15-25° | 25-35° | 0-15° | 15-25° | 25-35° | 0-15° | 15-25° | 25-35° | |
| WIND ZONE: HIGH (44M/ SEC) | METAL ROOF AND CEILING (40KG/M ²) | 200 x 44 | 5.5 | 5.2 | 4.9 | 4.9 | 4.6 | 4.3 | 4.4 | 4.3 | 4.0 |
| | | 240 x 44 | 6.4 | 6.1 | 5.6 | 5.9 | 5.6 | 5.2 | 5.4 | 5.2 | 4.9 |
| | | 300 x 44 | 7.4 | 7.0 | 6.5 | 6.8 | 6.5 | 6.0 | 6.4 | 6.1 | 5.6 |
| | | 360 x 44 | 8.4 | 8.0 | 7.4 | 7.7 | 7.4 | 6.8 | 7.3 | 6.9 | 6.4 |
| | TILED ROOF AND CEILING (90KG/M ²) | 200 x 44 | 4.3 | 4.1 | 3.8 | 3.8 | 3.6 | 3.4 | 3.4 | 3.3 | 3.1 |
| | | 240 x 44 | 5.2 | 5.0 | 4.7 | 4.6 | 4.4 | 4.1 | 4.2 | 4.0 | 3.8 |
| | | 300 x 44 | 6.2 | 5.9 | 5.5 | 5.6 | 5.4 | 5.0 | 5.1 | 4.9 | 4.6 |
| | | 360 x 44 | 7.1 | 6.8 | 6.3 | 6.5 | 6.2 | 5.7 | 6.1 | 5.8 | 5.3 |

Continuous Span - Supporting Roof and Ceiling - Up to High Wind Zone

| | LGL SIZE | MAX RAFTER SPAN (M) | | | | | | | | | |
|----------------------------|---|---------------------|--------|--------|----------------|--------|--------|-----------------|--------|--------|------|
| | | RAFTERS 600CRS | | | RAFTERS 900CRS | | | RAFTERS 1200CRS | | | |
| | | 0-15° | 15-25° | 25-35° | 0-15° | 15-25° | 25-35° | 0-15° | 15-25° | 25-35° | |
| WIND ZONE: HIGH (44M/ SEC) | METAL ROOF AND CEILING (40KG/M ²) | 200 x 44 | 7.0 | 6.6 | 6.1 | 6.4 | 6.1 | 5.6 | 6.0 | 5.7 | 5.3 |
| | | 240 x 44 | 8.1 | 7.7 | 7.1 | 7.4 | 7.0 | 6.5 | 6.9 | 6.6 | 6.1 |
| | | 300 x 44 | 9.3 | 8.8 | 8.2 | 8.5 | 8.1 | 7.5 | 8.0 | 7.7 | 7.1 |
| | | 360 x 44 | 10.5 | 10.0 | 9.3 | 9.7 | 9.3 | 8.6 | 9.2 | 8.7 | 8.1 |
| | TILED ROOF AND CEILING (90KG/M ²) | 200 x 44 | 5.8 | 5.5 | 5.1 | 5.1 | 4.9 | 4.6 | 4.7 | 4.5 | 4.2 |
| | | 240 x 44 | 6.8 | 6.4 | 6.0 | 6.1 | 5.9 | 5.4 | 5.7 | 5.5 | 5.1 |
| | | 300 x 44 | 7.8 | 7.5 | 6.9 | 7.1 | 6.8 | 6.3 | 6.7* | 6.4* | 5.9# |
| | | 360 x 44 | 8.9 | 8.5 | 7.9 | 8.2 | 7.8 | 7.2* | 7.6# | 7.3# | 6.7# |

* Denotes member must have min 65mm bearing at the internal support
 # Denotes member must have min 85mm bearing at the internal support

PLEASE NOTE:

These span tables provide maximum member spans up to 100% of the recommended capacity. For a premium floor or rafter system with minimal deflection, it is recommended that spans should be restricted to 85% of the maximum allowed.



Rafter Span - LPI I-Beam & Hyne LGL 44mm

Rafter Span - I-Built LVL 13 - 45mm

Single Span - Supporting Roof and Ceiling - Up to High Wind Zone

| | | LVL 13 SIZE | MAX RAFTER SPAN (M) | | | | | | | | |
|----------------------------------|--|-------------|---------------------|--------|--------|----------------|--------|--------|-----------------|--------|--------|
| | | | RAFTERS 600CRS | | | RAFTERS 900CRS | | | RAFTERS 1200CRS | | |
| | | | 0-15° | 15-25° | 25-35° | 0-15° | 15-25° | 25-35° | 0-15° | 15-25° | 25-35° |
| WIND ZONE: HIGH (44M/ SEC) | METAL ROOF AND CEILING (40KG/M ²) | 150 x 45 | 4.2 | 4.0 | 3.7 | 3.7 | 3.5 | 3.3 | 3.4 | 3.2 | 3.0 |
| | | 200 x 45 | 5.5 | 5.2 | 4.9 | 4.9 | 4.7 | 4.4 | 4.5 | 4.3 | 4.0 |
| | | 240 x 45 | 6.3 | 6.0 | 5.6 | 5.8 | 5.5 | 5.1 | 5.3 | 5.1 | 4.8 |
| | | 300 x 45 | 7.4 | 7.0 | 6.5 | 6.8 | 6.5 | 6.0 | 6.4 | 6.1 | 5.6 |
| | | 360 x 45 | 8.4 | 8.0 | 7.4 | 7.7 | 7.4 | 6.8 | 7.3 | 6.9 | 6.4 |
| | TILED ROOF AND CEILING (90KG/M ²) | 150 x 45 | 3.2 | 3.1 | 2.9 | 2.9 | 2.7 | 2.6 | 2.6 | 2.5 | 2.3 |
| | | 200 x 45 | 4.3 | 4.1 | 3.9 | 3.8 | 3.6 | 3.4 | 3.5 | 3.3 | 3.1 |
| | | 240 x 45 | 5.2 | 4.9 | 4.6 | 4.6 | 4.4 | 4.1 | 4.2 | 4.0 | 3.7 |
| | | 300 x 45 | 6.2 | 5.9 | 5.5 | 5.7 | 5.4 | 5.0 | 5.2 | 5.0 | 4.6 |
| | | 360 x 45 | 7.1 | 6.8 | 6.3 | 6.5 | 6.2 | 5.7 | 6.1 | 5.8 | 5.4 |

Continuous Span - Supporting Roof and Ceiling - Up to High Wind Zone

| | | LVL 13 SIZE | MAX RAFTER SPAN (M) | | | | | | | | |
|----------------------------------|--|-------------|---------------------|--------|--------|----------------|--------|--------|-----------------|--------|--------|
| | | | RAFTERS 600CRS | | | RAFTERS 900CRS | | | RAFTERS 1200CRS | | |
| | | | 0-15° | 15-25° | 25-35° | 0-15° | 15-25° | 25-35° | 0-15° | 15-25° | 25-35° |
| WIND ZONE: HIGH (44M/ SEC) | METAL ROOF AND CEILING (40KG/M ²) | 150 x 45 | 5.7 | 5.4 | 5.0 | 5.0 | 4.8 | 4.5 | 4.6 | 4.4 | 4.1 |
| | | 200 x 45 | 7.0 | 6.7 | 6.2 | 6.4 | 6.1 | 5.7 | 6.0 | 5.7 | 5.3 |
| | | 240 x 45 | 7.9 | 7.6 | 7.0 | 7.3 | 7.0 | 6.4 | 6.9 | 6.5 | 6.1 |
| | | 300 x 45 | 9.3 | 8.8 | 8.2 | 8.6 | 8.2 | 7.6 | 8.1 | 7.7 | 7.1 |
| | | 360 x 45 | 10.5 | 10.0 | 9.3 | 9.7 | 9.3 | 8.6 | 9.2 | 8.8 | 8.1 |
| | TILED ROOF AND CEILING (90KG/M ²) | 150 x 45 | 4.4 | 4.2 | 4.0 | 3.9 | 3.7 | 3.5 | 3.5 | 3.4 | 3.2 |
| | | 200 x 45 | 5.8 | 5.6 | 5.2 | 5.2 | 5.0 | 4.6 | 4.7 | 4.5 | 4.2 |
| | | 240 x 45 | 6.7 | 6.4 | 5.9 | 6.1 | 5.8 | 5.4 | 5.7 | 5.4 | 5.0 |
| | | 300 x 45 | 7.9 | 7.5 | 6.9 | 7.2 | 6.8 | 6.3 | 6.7 | 6.4 | 5.9 |
| | | 360 x 45 | 9.0 | 8.5 | 7.9 | 8.2 | 7.8 | 7.2 | 7.7 | 7.3 | 6.8* |

*Denotes member must have a minimum 45mm bearing at the 2 supports

PLEASE NOTE:

These span tables provide maximum member spans up to 100% of the recommended capacity. For a premium floor or rafter system with minimal deflection, it is recommended that spans should be restricted to 85% of the maximum allowed.



Single Span - Supporting Roof and Ceiling - Up to High Wind Zone

| | | LVL 13 SIZE | MAX RAFTER SPAN (M) | | | | | | | | |
|----------------------------------|--|-------------|---------------------|--------|--------|----------------|--------|--------|-----------------|--------|--------|
| | | | RAFTERS 600CRS | | | RAFTERS 900CRS | | | RAFTERS 1200CRS | | |
| | | | 0-15° | 15-25° | 25-35° | 0-15° | 15-25° | 25-35° | 0-15° | 15-25° | 25-35° |
| WIND ZONE: HIGH (44M/ SEC) | METAL ROOF AND CEILING (40KG/M ²) | 150 x 63 | 5.0 | 4.8 | 4.5 | 4.5 | 4.3 | 4.0 | 4.1 | 3.9 | 3.7 |
| | | 200 x 63 | 6.4 | 6.1 | 5.6 | 5.9 | 5.6 | 5.2 | 5.5 | 5.2 | 4.9 |
| | | 240 x 63 | 7.2 | 6.9 | 6.4 | 6.7 | 6.4 | 5.9 | 6.3 | 6.0 | 5.6 |
| | | 300 x 63 | 8.4 | 8.0 | 7.4 | 7.8 | 7.5 | 6.9 | 7.4 | 7.0 | 6.5 |
| | | 360 x 63 | 9.5 | 9.1 | 8.4 | 8.9 | 8.5 | 7.8 | 8.4 | 8.0 | 7.4 |
| | TILED ROOF AND CEILING (90KG/M ²) | 150 x 63 | 4.0 | 3.8 | 3.6 | 3.5 | 3.4 | 3.1 | 3.2 | 3.1 | 2.9 |
| | | 200 x 63 | 5.3 | 5.0 | 4.7 | 4.7 | 4.5 | 4.2 | 4.3 | 4.1 | 3.8 |
| | | 240 x 63 | 6.1 | 5.9 | 5.4 | 5.6 | 5.3 | 5.0 | 5.1 | 4.9 | 4.6 |
| | | 300 x 63 | 7.2 | 6.9 | 6.4 | 6.6 | 6.3 | 5.8 | 6.2 | 5.9 | 5.5 |
| | | 360 x 63 | 8.2 | 7.8 | 7.2 | 7.5 | 7.2 | 6.7 | 7.1 | 6.7 | 6.2 |

Continuous Span - Supporting Roof and Ceiling - Up to High Wind Zone

| | | LVL 13 SIZE | MAX RAFTER SPAN (M) | | | | | | | | |
|----------------------------------|--|-------------|---------------------|--------|--------|----------------|--------|--------|-----------------|--------|--------|
| | | | RAFTERS 600CRS | | | RAFTERS 900CRS | | | RAFTERS 1200CRS | | |
| | | | 0-15° | 15-25° | 25-35° | 0-15° | 15-25° | 25-35° | 0-15° | 15-25° | 25-35° |
| WIND ZONE: HIGH (44M/ SEC) | METAL ROOF AND CEILING (40KG/M ²) | 150 x 63 | 6.6 | 6.3 | 5.8 | 6.0 | 5.7 | 5.3 | 5.6 | 5.4 | 5.0 |
| | | 200 x 63 | 8.0 | 7.7 | 7.1 | 7.4 | 7.1 | 6.5 | 7.0 | 6.6 | 6.1 |
| | | 240 x 63 | 9.1 | 8.7 | 8.0 | 8.4 | 8.0 | 7.4 | 7.9 | 7.6 | 7.0 |
| | | 300 x 63 | 10.6 | 10.1 | 9.4 | 9.8 | 9.4 | 8.7 | 9.3 | 8.9 | 8.2 |
| | | 360 x 63 | 12.0 | 11.4 | 10.6 | 11.2 | 10.6 | 9.9 | 10.6 | 10.1 | 9.3 |
| | TILED ROOF AND CEILING (90KG/M ²) | 150 x 63 | 5.4 | 5.2 | 4.8 | 4.8 | 4.6 | 4.3 | 4.4 | 4.2 | 3.9 |
| | | 200 x 63 | 6.8 | 6.5 | 6.0 | 6.2 | 5.9 | 5.5 | 5.8 | 5.5 | 5.1 |
| | | 240 x 63 | 7.7 | 7.4 | 6.8 | 7.1 | 6.7 | 6.2 | 6.6 | 6.3 | 5.8 |
| | | 300 x 63 | 9.1 | 8.6 | 8.0 | 8.3 | 7.9 | 7.3 | 7.8 | 7.4 | 6.9 |
| | | 360 x 63 | 10.3 | 9.8 | 9.1 | 9.5 | 9.0 | 8.4 | 8.9 | 8.5 | 7.9 |

Rafter Span - I-Built LVL 13 - 63mm

PLEASE NOTE:

These span tables provide maximum member spans up to 100% of the recommended capacity. For a premium floor or rafter system with minimal deflection, it is recommended that spans should be restricted to 85% of the maximum allowed.



8.1 Pitching Block Detail


5.14

70 x 30 Web stiffeners, nail with 3/65 x 3.15 nails each side equally spaced.

Web stiffeners required each side of I-Beam bevel cut. Stiffeners to match roof pitch.

Fix in accordance with tie-down requirements of NZS3604. Refer detail 8.14

70 x 120 Pitching block or bevel top plate. To match pitch (Note pitching block method preferred)

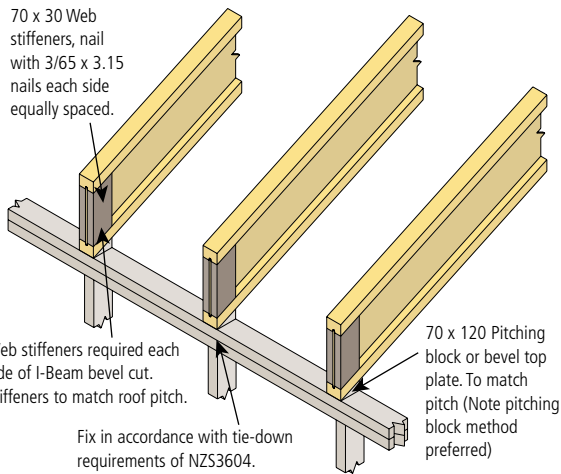

8.2 Standard Rafter Overhang Detail

5.15

Web stiffeners, nail using 3/65 x 3.15mm nails from each side

70 x 35 Nailing block to side of web
250mm Maximum taper cut
900mm Maximum overhang

Note: Greater eave overhangs can be achieved when designing rafters using the HD7 software

OPTION 1

70 x 120 Pitching block or bevel top plate


OPTION 2

Fascia

90mm Minimum
300mm Minimum
90mm Minimum when flange trimmed

ALTERNATIVE OPTION

RB21 Rimboard ripped down and fixed to both sides with 65 x 3.15 FH nails at 150mm centres along top and bottom

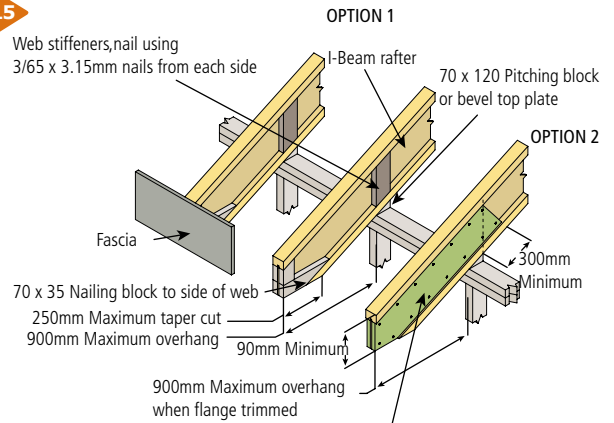

8.3 Rafter Birdsmouth Detail


5.16

Rafter centres
1200mm maximum light weight
900mm maximum heavy weight

Nail using 3/65 x 3.15mm nails from each side at each block


Birdsmouth cut at support, not deeper than 1/2 of flange thickness (16mm) Note: Min bearing at external support 32mm

ALTERNATIVE OPTION
RB21 Rimboard ripped down and fix to both sides with 65 x 3.15 FH nails at 150mm centres along top and bottom.

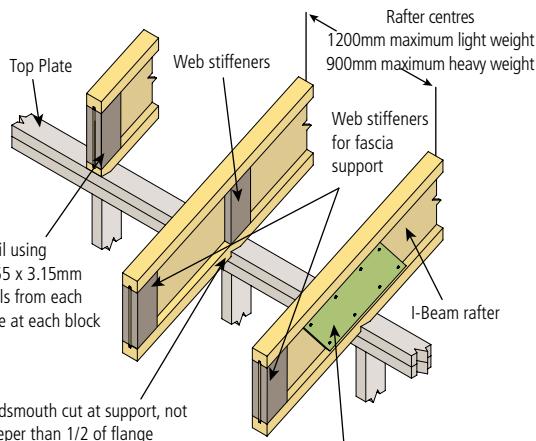


8.4 Rafter to Beam Connection

5.17




Pryda NPA to both sides. (Web stiffeners req)

Pryda NPA to both sides. (web stiffeners required)



8.5 Rafter Overhang Trim Detail


5.18

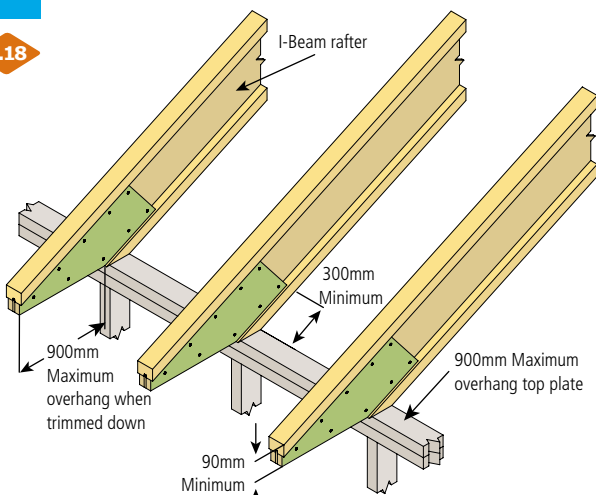

RB21 Rimboard ripped down and fix to both sides with 65 x 3.15 FH nails at 150mm centres along top and bottom

8.6 90 x 45 Overhang Outrigger

5.19

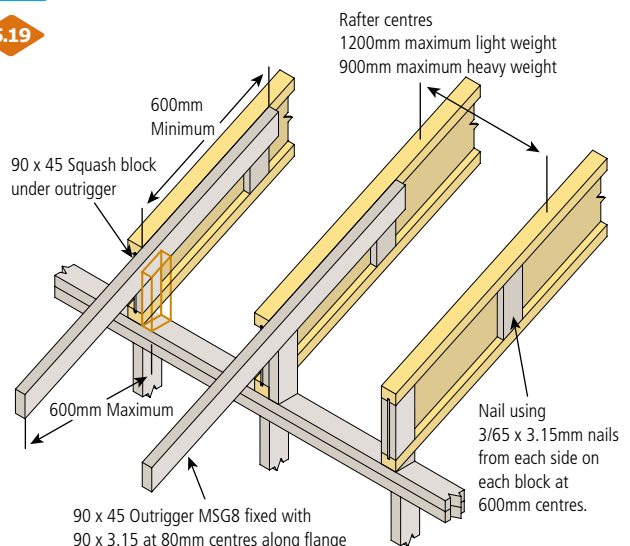


Refers to superseded detail number

Roof Details


8.7 Rafter to Ridge Beam / Roof Beam Connection

5.20

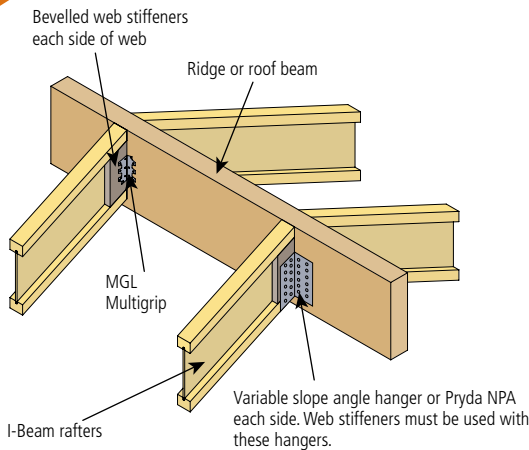


8.8 Ridge Over Detail

5.21

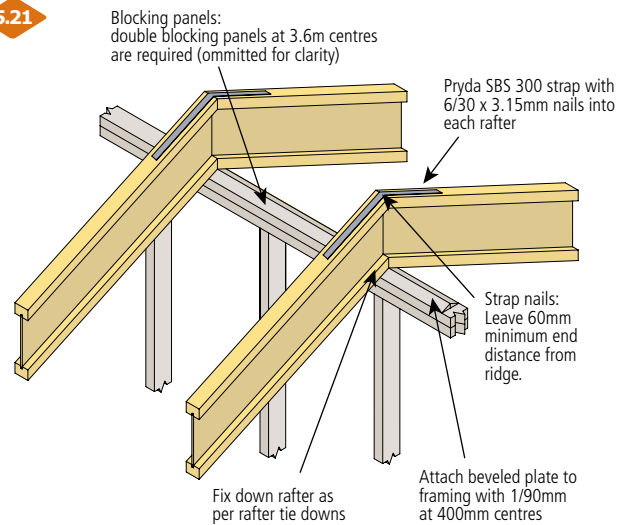


8.9 Hip Rafter Connection

5.22

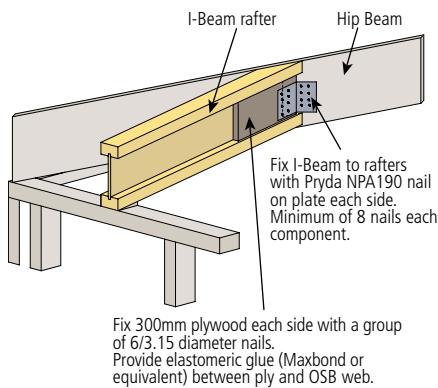


8.10 Web Stiffener Detail

5.23

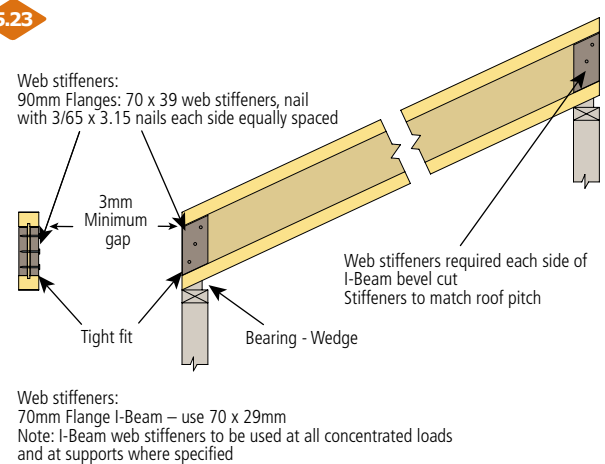


8.11 Gable End Rafter Detail

5.24

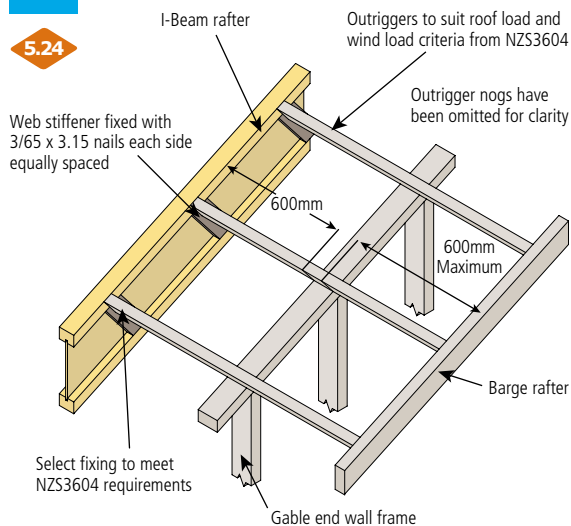

Hanger Fixings


8.12 Intermediate Bearing Detail

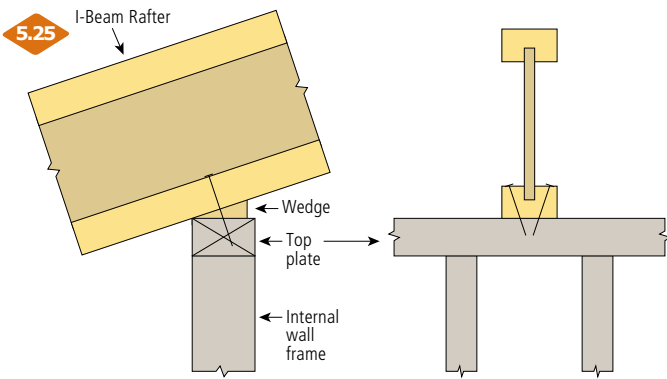

Fixing Requirements at Intermediate Bearing


| | |
|----------------------|---|
| FOR SLOPES < 18° | =1/75 x 3.15mm nail each side |
| FOR PITCHES 15-22.5° | =2/75 x 3.15mm nails each side |
| FOR PITCHES > 22.5° | =2/75 x 3.15 nails each side and tie down strap |

8.13 Rafter Tie Down Multigrip

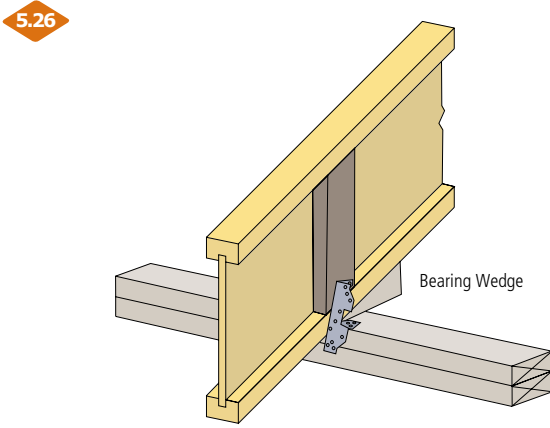


Site made wedge with Pryda Multigrip (MGL).
Use one each side. Tie-down reference: MGL.
Note: Refer NZS3604 for hold down requirements

8.14 Rafter Tie Down Cyclone Strap or Concealed Purlin Cleat

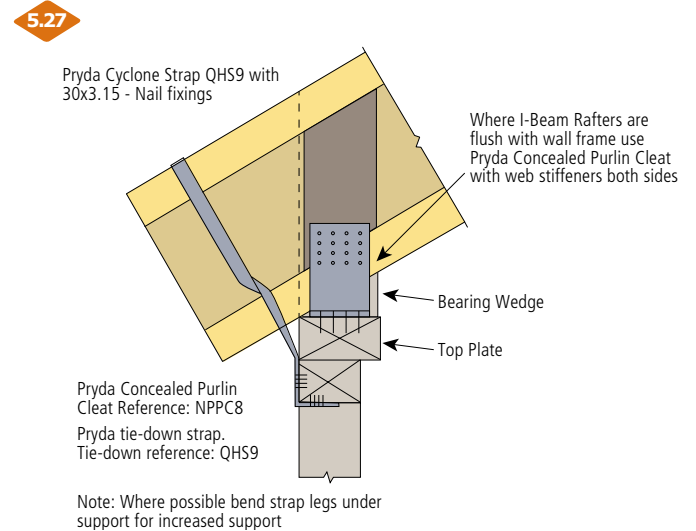

8.15 SolidStart™ I-Beam Cut Length Calculation


| PITCH FACTORS | | DISTANCE D (MM) | | | |
|---------------|--------------|-------------------|-----|-----|-----|
| PITCH (DEG) | PITCH FACTOR | RAFTER DEPTH (MM) | | | |
| | | 225 | 240 | 300 | 356 |
| 5 | 1.01 | 20 | 21 | 26 | 31 |
| 10 | 1.02 | 40 | 43 | 53 | 63 |
| 15 | 1.04 | 60 | 65 | 81 | 95 |
| 20 | 1.07 | 82 | 88 | 110 | 129 |
| 22.5 | 1.09 | 93 | 100 | 125 | 147 |
| 25 | 1.11 | 105 | 113 | 141 | 166 |
| 30 | 1.16 | 130 | 139 | 174 | 205 |
| 35 | 1.23 | 158 | 169 | 211 | 249 |

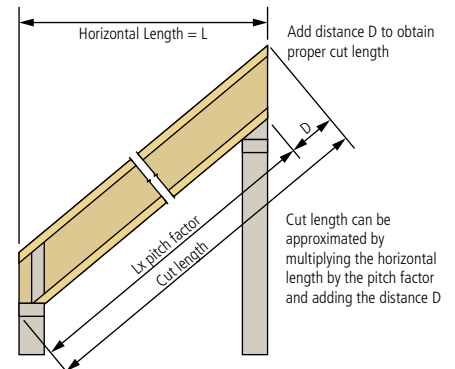

Avoid These Practices

A


8.0



DO NOT cut holes too close to support.

B


8.1



DO NOT bevel cut rafter beyond inside face of wall.

C


8.2



DO NOT bevel cut joist beyond inside face of wall

D


8.3

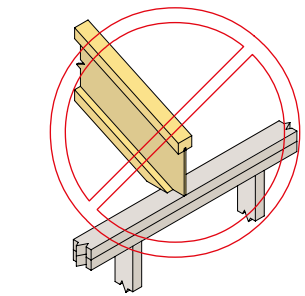

DO NOT overhang birdsmouth cut from inside face of plate.

E


8.4

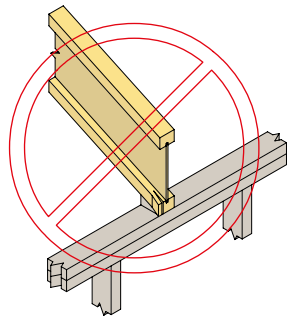

DO NOT split the flange.
Ensure the correct heel fixing is done.

F


8.5



DO NOT cut, notch or drill top or bottom chords.

G


8.6



I-Beam is not seated properly into the hanger, this may cause nail pullout or shear under load.

H


8.7

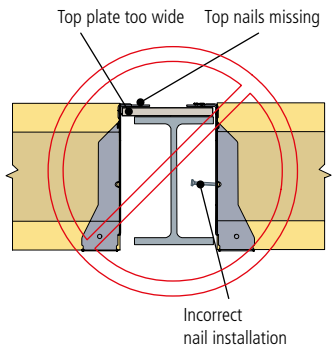

Top nailing is incorrect due to:
1. Top plate too thin or
2. Wrong length nail is used

I


8.8

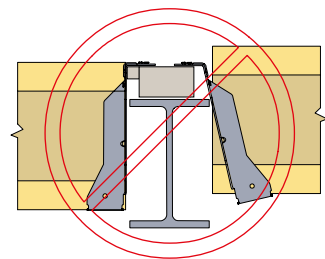

If the top plate is too narrow it may cause:
1. Hanger deformation
2. Nail pull-out or shear
3. Supporting beam deformation

J


8.9



Spreading hanger legs will push the I-Beam up which may cause uneven floors, squeaky floors and I-Beam rotation.


K

8.10

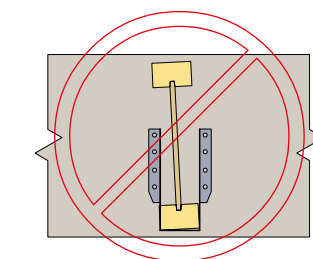

Hangers not supporting the top flange of the I-Beam will require stiffeners.

Avoid These Practices

 Refers to superseded detail number

Storage, Handling and Safety

As with other high quality products, Engineered Timber Products such as I-Beams, Edge Beams and 17C beams require proper storage and handling during distribution and at the job site in order to protect the product from damage. The following information provides techniques for safe and proper handling to minimise physical and moisture damage to our Engineered Timber Products.

Storage:

- Store bundles upright on a level and well drained surface. Beams should not be stored in direct contact with the ground and should always be protected from the weather. Ensure supports of packs do not exceed 3.0m apart.
- Bundles should remain wrapped, strapped and protected from the weather until time of installation.
- Always stack and handle I-Beams in the upright position.
- Twisting of joists or applying loads to the joists when flat can damage the joist.
- Avoid walking on wrapped and unwrapped product.
- Do not stack other materials on top of I-Beams, Edge beams and 17C beams.
- Follow good forklift safety procedures when handling Engineered timber Products in the yard and at building sites:
 - Use wide forks to handle long length material
 - Storage yard should be maintained to provide flat, well drained and level driving surface.
 - Do not handle or rotate loads over people
 - Do not bound or jerk loads
 - Maintain low forklift speeds and brake smoothly to prevent accidental dumping of loads.
 - Stabilise the load if there is a possibility of the load shifting
 - Maintain load height within safe limits

Handling:


- Use care when handling bundles and individual components to prevent injury to handlers or damage by forklifts or cranes.
- Do not lift or roll I-Beams by the top flange. This activity may cause damage to the beams.
- Avoid excessive bowing during all phases of handling and installation.
- Joists should remain vertical during handling
- Damaged Beams should not be used. Do not try to repair a damaged beam on site.
- Refer table for size/weight when handling. Please take these into account when handling timber

Safety Warning:


- Never walk on wrapped or unwrapped bundles.
- Do not walk on the joists until they are full installed or correctly braced, joists are unstable until braced laterally.
- During installation, a minimum of 100 x 50 temporary bracing at 2.4m CRS max is required.
- Only remove the bracing as the sheathing is being attached.
- Never overload joists with loads that exceed design limits.
- Stack building materials over walls or main beams only.
- Do not use I-Beams as ramps, planks or walkways.
- Brace each joist as it is erected.
- All hangers, rimboards and blocking at the end supports of the joists must be installed and nail properly.

THE ABOVE ARE GENERAL RECOMMENDATIONS AND IN SOME CASES ADDITIONAL PRECAUTIONS MAY BE REQUIRED


| TRANSPORTING I-BEAMS AND LGL BEAMS | | | |
|------------------------------------|-----------------|-----------------|------------------|
| BEAM TYPE | BEAM DEPTH (MM) | BEAM WIDTH (MM) | BEAM MASS (KG/M) |
| I-BEAM | | | |
| 225 LPI 70-T | 225 | 70 | 3.97 |
| 240 LPI 70-T | 240 | 70 | 4.07 |
| 300 LPI 53-T | 300 | 53 | 3.75 |
| 300 LPI 70-T | 300 | 70 | 4.48 |
| 356 LPI 70-T | 356 | 70 | 4.84 |
| EDGE BEAM | | | |
| 200X44 | 200 | 44 | 4.7 |
| 245X44 | 245 | 44 | 5.6 |
| 300X44 | 300 | 44 | 7 |
| 17C LGL | | | |
| 295X85 | 295 | 85 | 16.3 |
| 330X85 | 330 | 85 | 18.2 |
| 360X85 | 360 | 85 | 19.9 |
| 425X85 | 425 | 85 | 23.5 |
| 460X85 | 460 | 85 | 25.4 |




I-Beams in the upright position.




DO NOT stack or handle I-Beams flat.



- Keep I-Beams elevated and place on solid, dry and level surface.
- Ensure supports of packs do not exceed 3.0m apart.
- Ensure wrapping remains on packs to protect I-Beams from the elements.



- Where large quantities of beams are delivered to site, appropriate lifting devices should be used to remove packs from trucks.
- DO NOT use steel bars to push packs off trucks.

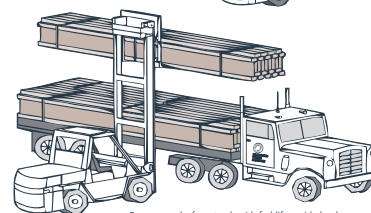


- Remove packs from truck with forklift or side loader.
- DO NOT use steel bars to lower or push packs off truck.




DO NOT lift or roll I-Beams by the top flange.



DO NOT lift I-Beams whilst they are lying flat. Excessive flapping may cause damage.

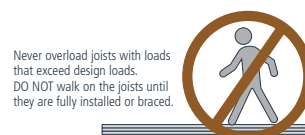

Never overload joists with loads that exceed design loads. DO NOT walk on the joists until they are fully installed or braced.

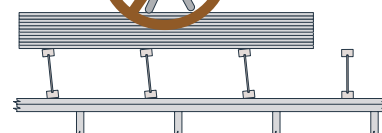

All I-Built products are available in the following treatment options: I-Beams - LOSP H3.1 and untreated; LGL Edgebeams - LOSP H3.1; 17C - LOSP H3.1; I-Built LVL - Untreated, H1.2 and LOSP H3.1. For treated timber, please read the following information carefully before handling the product.

LIGHT ORGANIC SOLVENT PRESERVATIVES (LOSP):

Light Organic Solvent-borne Preservatives (LOSP's):

Are preservatives that contain combinations of fungicides and insecticides for timber used in internal and external situations. All of these preservatives components are incorporated in a solvent carrier such as white spirit.

Copper Chrome and Arsenic (CCA) Treatment:

Copper Chrome and Arsenic preservative contains copper and arsenic to protect against fungal decay and wood boring insects and chromium to fix the preservative to the cell structure in the wood.

The following information is designed to inform builders, pre-nailers and merchants of the correct procedures for handling and storing treated timber.

HANDLING PRODUCTS TREATED WITH LOSP AND CCA

Some people may experience temporary skin irritation, headaches or light headedness when handling LOSP or CCA treated timber. These undesirable effects are more likely if the timber is not solvent dry.

The following precautions should be taken when handling LOSP/CCA treated timber.

- Where possible packs should be opened a day or 2 before use to allow any residual vapours in the inner boards to evaporate.
- LOSP/CCA treated timber should be stored in a well-ventilated under cover area with any protective wrapping removed.
- Wear gloves and long sleeves for protection against splinters and cuts during handling. If the timber is still damp from treatment, either do not handle or solvent resistant gloves are recommended.
- Wear protective glasses and a filter mask when sawing, sanding or machining treated timber.
- If LOSP/CCA preservative or treated sawdust accumulates on clothes, wash separately before reuse.
- Always wash hands and any exposed areas after handling LOSP/CCA treated timber, especially before eating.
- If undesirable effects occur cease handling or using the material and review your personal protection measures.
- Do not transport LOSP/CCA treated timber in an enclosed environment.

STORAGE

- Always ensure LOSP/CCA treated timber is stored in a well-ventilated space
- Merchants, builders and pre-nailers should remove wrapping off delivered material as soon as convenient to assist in the dissipation of solvent fumes.
- Stored LOSP/CCA treated timber should not be kept in a confined area. Store only in areas that have double ventilated openings or an extraction system.

DISPOSAL

- Dispose of all sawdust and off cuts after construction.
- For normal domestic and trade users, dispose of waste through normal waste collection and disposal services, refer to waste collection guides.
- LOSP/CCA treated timber must not be burned in open fires, stoves, fireplaces or any confined spaces as toxic fumes may be released.

TREATMENT OF CUTS, HOLES AND NOTCHES

NZWOOD recommends that all cuts, holes and notches are coated with generous amounts of preservatives:

H3.1 LOSP – Koppers Arch Enseal clear/green or similar preservative.

H3.2 CCA – A suitable copper or Zinc naphthenate based primer.


IDENTIFYING TREATED TIMBER ON SITE

Untreated timber will have no marking on it. Treated timber will have the following markings repeated along length.

I-Beam



LGL Edgebeam

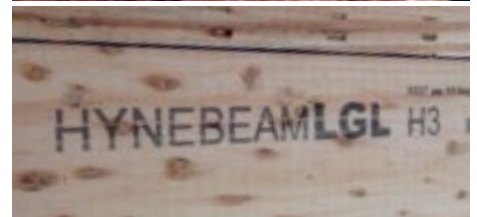

17C



Rimboard



PLEASE NOTE:

All treated and untreated I-Beams, Edgebeams, 17Cs and Rimboard are not suitable for weather exposed situations.

I BUILT™

Building Systems



Mailing Address:

PO Box 13647
Onehunga
Auckland 1643
New Zealand

Telephone: +64 9 276 7030
Fax: +64 9 270 0504

Customer Services

Freephone: 0800 022 352
Freefax: 0800 022 357
Email: sales@nzwoodproducts.co.nz

Technical Assistance:

Freephone: 0800 022 352
Freefax: 0800 022 357
Email: techinfo@nzwoodproducts.co.nz

Website:

www.nzwoodproducts.co.nz



You are welcome to contact us for further information about the range of Engineered Timber Products, our Rimboard and Pryda fittings

